


# Ex-proof digital proportional directional valves high performance

direct, with LVDT transducer, on-board driver and positive spool overlap - **ATEX and IECEx**

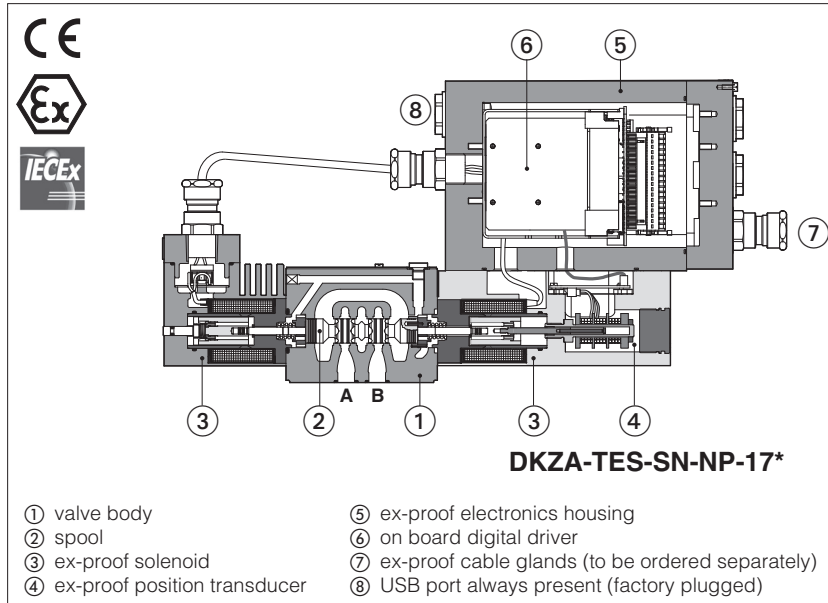

## DHZA-TES, DKZA-TES

Ex-proof digital high performances proportional valves, direct, with LVDT position transducer and positive spool overlap for best dynamics in directional controls and not compensated flow regulations.

They are equipped with ex-proof on-board digital driver, LVDT transducer and proportional solenoids certified for safe operations in hazardous environments with potentially explosive atmosphere.

- Multicertification **ATEX** and **IECEx** for gas group **II 2G** and dust category **II 2D**

The flameproof enclosure of integral digital driver and solenoid prevents the propagation of accidental internal sparks or fire to the external environment.

The driver and solenoid are also designed to limit the surface temperature within the classified limits.

### DHZA:

Size: **06** - ISO 4401

Max flow: **60 l/min**

Max pressure: **350 bar**

### DKZA:

Size: **10** - ISO 4401

Max flow: **150 l/min**

Max pressure: **315 bar**

## 1 MODEL CODE

<b>DHZA</b>	-	<b>T</b>	-	<b>ES</b>	-	<b>SN</b>	-	<b>NP</b>	-	<b>0</b>	-	<b>71</b>	-	<b>L</b>	-	<b>5</b>	/	<b>M</b>	/	<b>*</b>	/	<b>*</b>
<p>Ex-proof proportional directional valves, direct</p> <p><b>DHZA</b> = size 06 <b>DKZA</b> = size 10</p> <p><b>T</b> = with one LVDT transducer</p> <p><b>ES</b> = full integral driver</p> <p><b>Alternated P/Q controls</b>, see section 5:</p> <p><b>SN</b> = none <b>SP</b> = pressure control (1 pressure transducer) <b>SF</b> = force control (2 pressure transducers) <b>SL</b> = force control (1 load cell)</p> <p><b>Fieldbus interface</b>, USB port always present:</p> <p><b>NP</b> = Not Present <b>BC</b> = CANopen <b>BP</b> = PROFIBUS DP <b>EH</b> = EtherCAT <b>EW</b> = POWERLINK <b>EI</b> = EtherNet/IP <b>EP</b> = PROFINET RT/IRT</p> <p><b>Valve size ISO 4401:</b> <b>0</b> = 06    <b>1</b> = 10</p>																						
<p style="text-align: right;"><b>Seals material</b>, see section 9:</p> <p>- = NBR <b>PE</b> = FKM <b>BT</b> = HNBR</p> <p style="text-align: right;">Series number</p>																						

- Hydraulic options (2):**
- B** = solenoid with integral digital electronics at side of port A (3)
  - Y** = external drain
- Electronic options (2):**
- C** = current feedback for pressure transducer 4 ÷ 20 mA, only for **SP, SF, SL** (omit for std voltage ±10 Vdc)
  - I** = current reference input and monitor 4÷20mA (omit for std voltage ±10Vdc)



**Cable entrance threaded connection:**  
**M** = M20x1,5

**Spool size:** **14** (L) **1** (L) **2** (S) **3** (L,S,D) **5** (L,S,D,Q)

DHZA	=	1	4,5	8	18	28
DKZA	=	-	-	-	45	75

Nominal flow (l/min) at Δp 10 bar P-T

## Spool type - regulating characteristics:

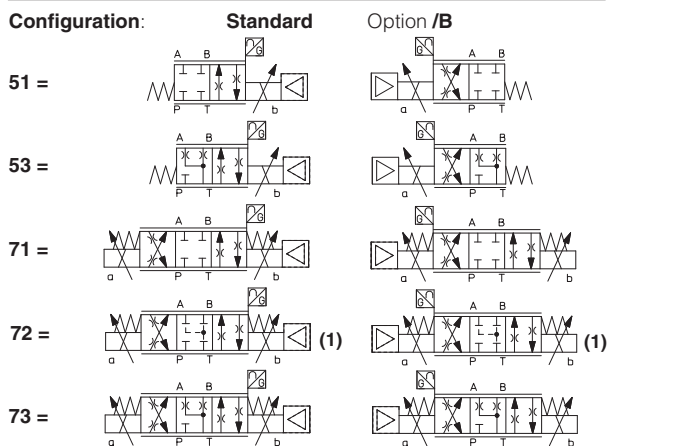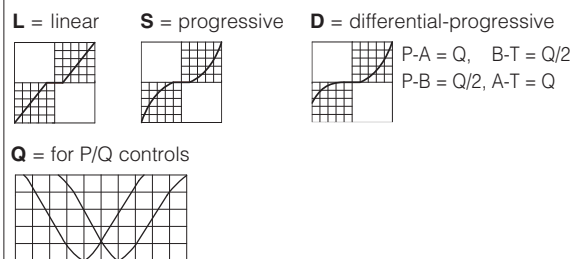

(1) Only for **DKZA\*-S5** the spool overlapping type 2 provides the same characteristic of type 1, but in central position the internal leakages from P to A and B are drained to tank, avoiding the drift of cylinders with differential areas    (2) For possible combined options, see section 15  
(3) In standard configuration the solenoid with integral electronics and position transducer are at side port B

## 2 GENERAL NOTES

Atos digital proportionals valves are CE marked according to the applicable directives (e.g. Immunity and Emission EMC Directive). Installation, wirings and start-up procedures must be performed according to the general prescriptions shown in tech table **F003** and in the user manuals included in the E-SW-\* programming software.

## 3 VALVE SETTINGS AND PROGRAMMING TOOLS


**WARNING:** the below operation must be performed in a safety area

Valve's functional parameters and configurations, can be easily set and optimized using Atos E-SW programming software connected via USB port to the digital driver (see table **GS003**). For fieldbus versions, the software permits valve's parameterization through USB port also if the driver is connected to the central machine unit via fieldbus.

The software is available in different versions according to the driver's options (see table **GS500**):

<b>E-SW-BASIC</b>	support: NP (USB)	PS (Serial)	IR (Infrared)
<b>E-SW-FIELDBUS</b>	support: BC (CANopen)	BP (PROFIBUS DP)	EH (EtherCAT)
	EW (POWERLINK)	EI (EtherNet/IP)	EP (PROFINET)
<b>E-SW-*/PQ</b>	support: valves with SP, SF, SL alternated control (e.g. E-SW-BASIC/PQ)		

### USB or Bluetooth connection

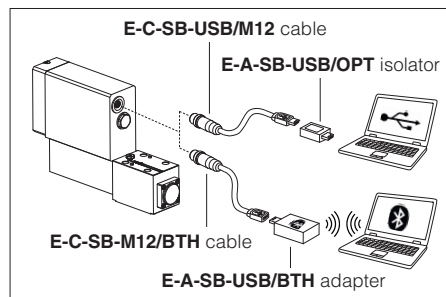

**WARNING: drivers USB port is not isolated!** For E-C-SB-USB/M12 cable, the use of isolator adapter is highly recommended for PC protection

**WARNING: Bluetooth adapter is available only for European, USA and Canadian markets!** Bluetooth adapter is certified according RED (Europe), FCC (USA) and ISED (Canada) directives

## 4 FIELDBUS - see tech. table **GS510**

Fieldbus allows valve direct communication with machine control unit for digital reference, valve diagnostics and settings. These execution allow to operate the valves through fieldbus or analog signals available on the terminal board.

## 5 ALTERNATED P/Q CONTROLS - see tech. table **FX500**

**S\*** options add the closed loop control of pressure (**SP**) or force (**SF** and **SL**) to the basic functions of proportional directional valves flow regulation. A dedicated algorithm alternates pressure (force) depending on the actual hydraulic system conditions.

An additional connector is available for transducers to be interfaced to the valve's driver (1 pressure transducer for SP, 2 pressure transducers for SF or 1 load cell for SL). The alternated pressure control (SP) is possible only for specific installation conditions.

## 6 GENERAL CHARACTERISTICS

Assembly position	Any position
Subplate surface finishing to ISO 4401	Acceptable roughness index, Ra ≤0,8 recommended Ra 0,4 - flatness ratio 0,01/100
MTTFd valves according to EN ISO 13849	150 years, see technical table P007
Ambient temperature range	<b>Standard</b> = -20°C ÷ +60°C <b>/PE</b> option = -20°C ÷ +60°C <b>/BT</b> option = -40°C ÷ +60°C
Storage temperature range	<b>Standard</b> = -20°C ÷ +70°C <b>/PE</b> option = -20°C ÷ +70°C <b>/BT</b> option = -40°C ÷ +70°C
Surface protection	Zinc coating with black passivation - salt spray test (EN ISO 9227) > 200 h
Compliance	Explosion proof protection, see section <b>11</b> -Flame proof enclosure "Ex d" -Dust ignition protection by enclosure "Ex t" RoHs Directive 2011/65/EU as last update by 2015/65/EU REACH Regulation (EC) n°1907/2006

**7 HYDRAULIC CHARACTERISTICS** - based on mineral oil ISO VG 46 at 50 °C

Valve model	DHZA					DKZA		
Pressure limits [bar]	ports <b>P, A, B</b> = 350; <b>T</b> = 210 (250 with external drain /Y) <b>Y</b> = 10					ports <b>P, A, B</b> = 315; <b>T</b> = 210 (250 with external drain /Y) <b>Y</b> = 10		
Configuration	<b>51, 53, 71, 73</b>					<b>51, 53, 71, 73</b>		<b>72</b>
Spool Type	<b>L14</b>	<b>L1</b>	<b>S2</b>	<b>L3, S3, D3</b>	<b>L5, S5, D5, Q5</b>	<b>L3, S3, D3</b>	<b>L5, S5, D5, Q5</b>	<b>S5</b>
Nominal flow [l/min] at $\Delta p = 10$ bar	1	4,5	8	18	28	45	75	75
$\Delta p$ P-T at $\Delta p = 30$ bar	1,7	8	14	30	50	80	130	130
max permissible flow	2,6	12	21	40	60	90	150	150
$\Delta p$ max P-T [bar]	70	70	70	50	50	40	40	40
Leakage [cm <sup>3</sup> /min]	<30 (at p = 100 bar); <135 (at p = 350 bar)					<80 (at p = 100 bar); <600 (at p = 315 bar)		
Response time <b>(1)</b> [ms]	$\leq 30$					$\leq 40$		
Hysteresis	$\leq 0,2$ [% of max regulation]							
Repeatability	$\pm 0,1$ [% of max regulation]							
Thermal drift	zero point displacement < 1% at $\Delta T = 40^\circ\text{C}$							

**(1)** (0-100% step signal)


**8 ELECTRICAL CHARACTERISTICS**

Power supplies	Nominal : +24 VDC Rectified and filtered : $V_{RMS} = 20 \div 32 V_{MAX}$ (ripple max 10 % $V_{PP}$ )			
Max power consumption	35 W			
Analog input signals	Voltage: range $\pm 10$ VDC (24 $V_{MAX}$ tollerant) Current: range $\pm 20$ mA		Input impedance: $R_i > 50$ k $\Omega$ Input impedance: $R_i = 500$ $\Omega$	
Insulation class	H (180°) Due to the occuring surface temperatures of the solenoid coils, the European standards ISO 13732-1 and EN982 must be taken into account			
Monitor outputs	Output range: voltage $\pm 10$ Vdc @ max 5 mA current $\pm 20$ mA @ max 500 $\Omega$ load resistance			
Enable input	Range: 0 $\div$ 5 Vdc (OFF state), 9 $\div$ 24 VDC (ON state), 5 $\div$ 9 VDC (not accepted); Input impedance: $R_i > 10$ k $\Omega$			
Fault output	Output range: 0 $\div$ 24 Vdc (ON state > [power supply - 2 V] ; OFF state < 1 V ) @ max 50 mA; external negative voltage not allowed (e.g. due to inductive loads)			
Pressure/force transducer power supply (only for SP, SF, SL)	+24Vdc @ max 100 mA (E-ATRA-7 see tech table <b>GX800</b> )			
Alarms	Solenoid not connected/short circuit, cable break with current reference signal, over/under temperature, valve spool transducer malfunctions			
Protection degree to DIN EN60529	IP66/67 with relevant cable gland			
Duty factor	Continuous rating (ED=100%)			
Tropicalization	Tropical coating on electronics PCB			
Additional characteristics	Short circuit protection of solenoid current supply; spool position control (SN) or pressure/force control (SP, SF, SL) by P.I.D. with rapid solenoid switching; protection against reverse polarity of power supply			
Electromagnetic compatibility (EMC)	According to Directive 2014/30/UE (Immunity: EN 61000-6-2; Emission: EN 61000-6-3)			
Communication interface	USB Atos ASCII coding	CANopen EN50325-4 + DS408	PROFIBUS DP EN50170-2/IEC61158	EtherCAT, POWERLINK, EtherNet/IP, PROFINET IO RT / IRT EC 61158
Communication physical layer	not insulated USB 2.0 + USB OTG	optical insulated CAN ISO11898	optical insulated RS485	Fast Ethernet, insulated 100 Base TX

**Note:** a maximum time of 800 ms (depending on communication type) have been considered between the driver energizing with the 24 Vdc power supply and when the valve is ready to operate. During this time the current to the valve coils is switched to zero

**9 SEALS AND HYDRAULIC FLUIDS** - for other fluids not included in below table, consult our technical office

Seals, recommended fluid temperature	NBR seals (standard) = $-20^\circ\text{C} \div +60^\circ\text{C}$ , with HFC hydraulic fluids = $-20^\circ\text{C} \div +50^\circ\text{C}$ FKM seals (/PE option) = $-20^\circ\text{C} \div +80^\circ\text{C}$ HNBR seals (/BT option) = $-40^\circ\text{C} \div +60^\circ\text{C}$ , with HFC hydraulic fluids = $-40^\circ\text{C} \div +50^\circ\text{C}$		
Recommended viscosity	20 $\div$ 100 mm <sup>2</sup> /s - max allowed range 15 $\div$ 380 mm <sup>2</sup> /s		
Max fluid contamination level	normal operation	ISO4406 class 18/16/13 NAS1638 class 7	see also filter section at
	longer life	ISO4406 class 16/14/11 NAS1638 class 5	www.atos.com or KTF catalog
<b>Hydraulic fluid</b>	<b>Suitable seals type</b>	<b>Classification</b>	<b>Ref. Standard</b>
Mineral oils	NBR, FKM, HNBR	HL, HLP, HLPD, HVLP, HVLPD	DIN 51524
Flame resistant without water	FKM	HFDU, HFDR	ISO 12922
Flame resistant with water <b>(1)</b>	NBR, HNBR	HFC	

 The ignition temperature of the hydraulic fluid must be 50°C higher than the max solenoid surface temperature

**(1) Performance limitations in case of flame resistant fluids with water:**

- max operating pressure = 210 bar
- max fluid temperature = 50°C

## 10 CERTIFICATION DATA

Valve type	DHZA, DKZA				
Certifications	Multicertification and Group II <b>ATEX IECEx</b>				
Solenoid certified code	<b>OZA-AES</b>				
Type examination certificate (1)	• ATEX: TUV IT 18 ATEX 068 X		• IECEx: IECEx TPS 19.0004X		
Method of protection	• ATEX 2014/34/EU Ex II 2G Ex db IIC T6/T5/T4 Gb Ex II 2D Ex tb IIIC T85°C/T100°C/T135°C Db		• IECEx Ex db IIC T6/T5/T4 Gb Ex tb IIIC T85°C/T100°C/T135°C Db		
Temperature class	Single solenoid valve	<b>T6</b>	-	<b>T5</b>	<b>T4</b>
	Double solenoid valve	-	<b>T4</b>	-	<b>T3</b>
Surface temperature	≤ 85 °C	≤ 135 °C	≤ 100 °C	≤ 135 °C	≤ 200 °C
Ambient temperature (2)	-40 ÷ +40 °C		-40 ÷ +55 °C		-40 ÷ +70 °C
Applicable Standards	EN 60079-0 EN 60079-1	EN 60079-31	IEC 60079-0 IEC 60079-1	IEC 60079-31	
Cable entrance: threaded connection	<b>M</b> = M20x1,5				

(1) The type examiner certificates can be downloaded from [www.atos.com](http://www.atos.com) - catalog on line, **technical information** section

(2) The solenoids **Group II** are certified for minimum ambient temperature -40°C

**! WARNING: service work performed on the valve by the end users or not qualified personnel invalidates the certification.**

## 11 CABLE SPECIFICATION AND TEMPERATURE - Power supply and grounding cables have to comply with following characteristics:

<b>Power supply and signals:</b> section of wire = 1,0 mm <sup>2</sup>	<b>Grounding:</b> section of external ground wire = 4 mm <sup>2</sup>
------------------------------------------------------------------------	-----------------------------------------------------------------------

### 11.1 Cable temperature

The cable must be suitable for the working temperature as specified in the "safety instructions" delivered with the first supply of the products.

Max ambient temperature [°C]	Temperature class	Max surface temperature [°C]	Min. cable temperature [°C]
40 °C	T6	85 °C	80 °C
55 °C	T5	100 °C	90 °C
70 °C	T4	135 °C	110 °C

## 12 CABLE GLANDS

Cable glands with threaded connections M20x1,5 for standard or armoured cables have to be ordered separately, see tech table **KX800**

**Note:** a Loctite sealant type 545, should be used on the cable gland entry threads

## 13 HYDRAULIC OPTIONS

**B** = Solenoid, integral electronics and position transducer at side of port A of the main stage. For hydraulic configuration vs reference signal, see 17.1

**Y** = Option /Y is mandatory if the pressure in port T exceeds 210 bar

## 14 ELECTRONIC OPTIONS

**I** = It provides 4 ÷ 20 mA current reference signal, instead of the standard ±10 VDC.

Input signal can be reconfigured via software selecting between voltage and current, within a maximum range of ±10 VDC or ±20 mA.

It is normally used in case of long distance between the machine control unit and the valve or where the reference signal can be affected by electrical noise; the valve functioning is disabled in case of reference signal cable breakage.

**C** = Only for **SP, SF, SL**

Option /C is available to connect pressure (force) transducers with 4 ÷ 20 mA current output signal, instead of the standard ±10 VDC.








Input signal can be reconfigured via software selecting between voltage and current, within a maximum range of ±10 VDC or ±20 mA.

## 15 POSSIBLE COMBINED OPTIONS:

**For SN:** /BI, /BY, /IY

**For SP, SF, SL:** /BI, /BY, /IY, /CI, /BCI, CIY, BCIY

16.1 Regulation diagrams - values measure at Δp 30 bar P-T

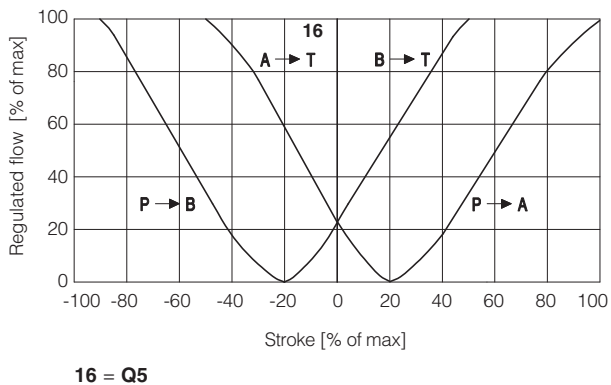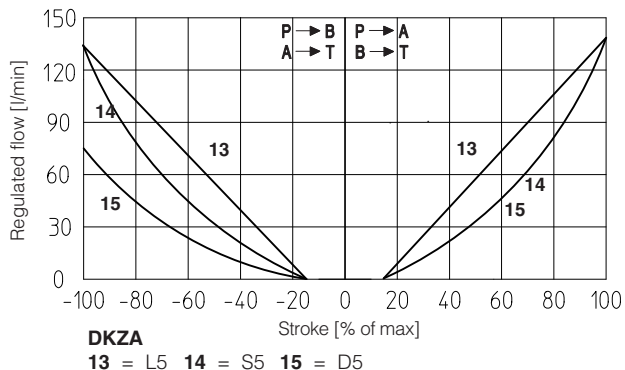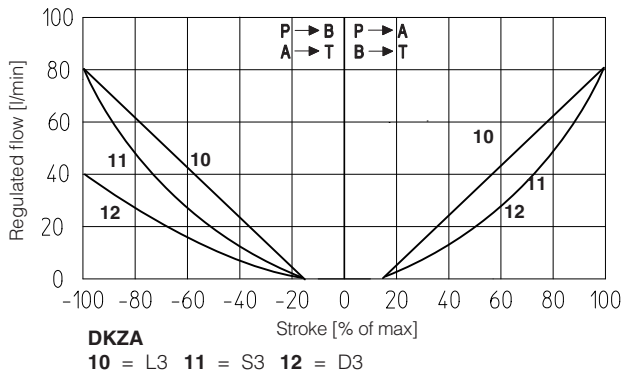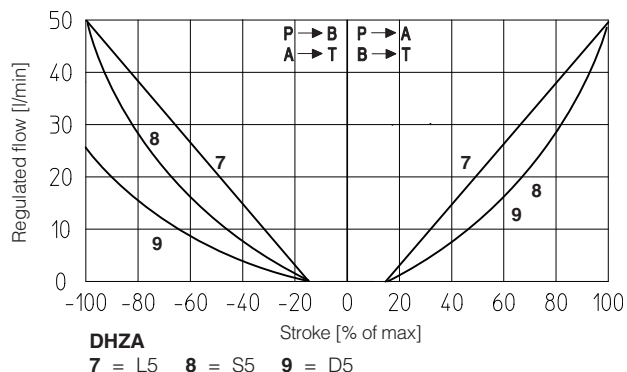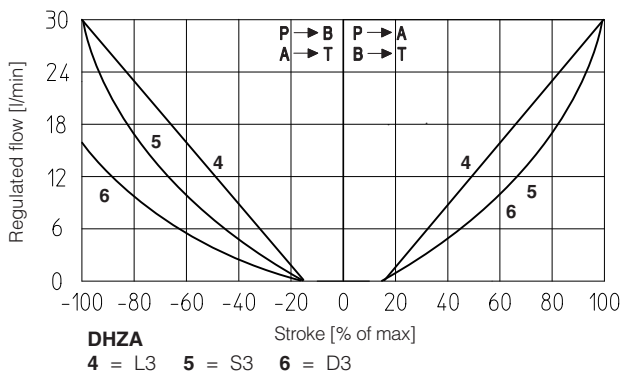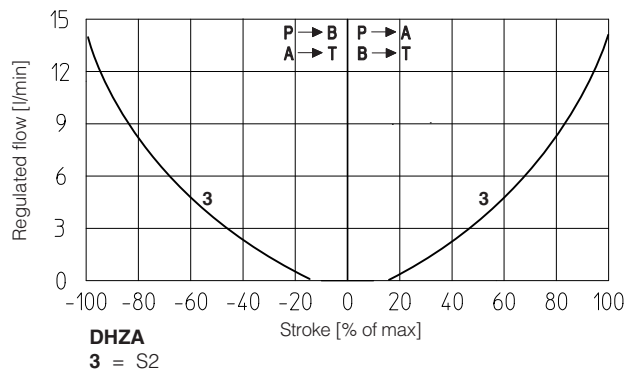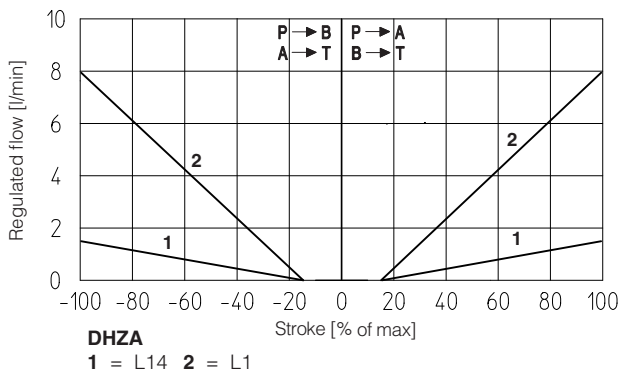

Q5 spool type is specific for alternate P/Q controls in combination with S\* option of digital integral drivers (see tech table **FX500**). It allows to control the pressure in A port or B port and it provides a safety central position (A-T/B-T) to depressurize the actuator chambers. The strong meter-in characteristic makes the spool suitable for both pressure control and motion regulations in several applications.

**Note:**

Hydraulic configuration vs. reference signal for configurations 71 and 73 (standard and option /B)

Reference signal  $\left. \begin{matrix} 0 \div +10 \text{ V} \\ 12 \div 20 \text{ mA} \end{matrix} \right\} P \rightarrow A / B \rightarrow T$       Reference signal  $\left. \begin{matrix} 0 \div -10 \text{ V} \\ 12 \div 4 \text{ mA} \end{matrix} \right\} P \rightarrow B / A \rightarrow T$

## 17 POWER SUPPLY AND SIGNALS SPECIFICATIONS

Generic electrical output signals of the valve (e.g. fault or monitor signals) must not be directly used to activate safety functions, like to switch-ON/OFF the machine's safety components, as prescribed by the European standards (Safety requirements of fluid technology systems and components-hydraulics, EN-982).

### 17.1 Power supply (V+ and V0)


The power supply must be appropriately stabilized or rectified and filtered: apply at least a 10000  $\mu$ F/40 V capacitance to single phase rectifiers or a 4700  $\mu$ F/40 V capacitance to three phase rectifiers.

 A safety fuse is required in series to each power supply: 2,5 A time lag fuse.

### 17.2 Power supply for driver's logic and communication (VL+ and VL0)

The power supply for driver's logic and communication must be appropriately stabilized or rectified and filtered: apply at least a 10000  $\mu$ F/40 V capacitance to single phase rectifiers or a 4700  $\mu$ F/40 V capacitance to three phase rectifiers.

The separate power supply for driver's logic on pin 3 and 4, allow to remove solenoid power supply from pin 1 and 2 maintaining active the diagnostics, USB and fieldbus communications.

 A safety fuse is required in series to each driver's logic and communication power supply: 500 mA fast fuse.

### 17.3 Flow reference input signal (Q\_INPUT+)

The driver controls in closed loop the valve spool position proportionally to the external reference input signal.

Reference input signal is factory preset according to selected valve code, defaults are  $\pm 10$  Vdc for standard and  $4 \div 20$  mA for /I option.

Input signal can be reconfigured via software selecting between voltage and current, within a maximum range of  $\pm 10$  VDC or  $\pm 20$  mA.

Drivers with fieldbus interface can be software set to receive reference signal directly from the machine control unit (fieldbus reference). Analog reference input signal can be used as on-off commands with input range  $0 \div 24$ VDC.

### 17.4 Pressure or force reference input signal (F\_INPUT+) - only SP, SF, SL

Functionality of F\_INPUT+ signal (pin 12), is used as reference for the driver pressure/force closed loop (see tech. table FX500).

Reference input signal is factory preset according to selected valve code, defaults are  $\pm 10$  Vdc for standard and  $4 \div 20$  mA for /I option.

Input signal can be reconfigured via software selecting between voltage and current, within a maximum range of  $\pm 10$  VDC or  $\pm 20$  mA.

Drivers with fieldbus interface can be software set to receive reference signal directly by the machine control unit (fieldbus reference).

Analog reference input signal can be used as on-off commands with input range  $0 \div 24$ VDC.

### 17.5 Flow monitor output signal (Q\_MONITOR)

The driver generates an analog output signal proportional to the actual spool position of the valve; the monitor output signal can be software set to show other signals available in the driver (e.g. analog reference, fieldbus reference, pilot spool position).

Monitor output signal is factory preset according to selected valve code, defaults are  $\pm 10$  VDC for standard and  $4 \div 20$  mA for /I option.

Output signal can be reconfigured via software selecting between voltage and current, within a maximum range of  $\pm 10$  VDC or  $\pm 20$  mA.

### 17.6 Pressure or force monitor output signal (F\_MONITOR) - only for SP, SF, SL

The driver generates an analog output signal proportional to alternated pressure/force control; the monitor output signal can be software set to show other signals available in the driver (e.g. analog reference, force reference).

Monitor output signal is factory preset according to selected valve code, defaults are  $\pm 10$  VDC for standard and  $4 \div 20$  mA for /I option.

Output signal can be reconfigured via software selecting between voltage and current, within a maximum range of  $\pm 10$  VDC or  $\pm 20$  mA.

### 17.7 Enable input signal (ENABLE)

To enable the driver, supply a 24 VDC on pin 6: Enable input signal allows to enable/disable the current supply to the solenoid, without removing the electrical power supply to the driver; it is used to active the communication and the other driver functions when the valve must be disabled for safety reasons. This condition **does not comply** with norms IEC 61508 and ISO 13849.

Enable input signal can be used as generic digital input by software selection.

### 17.8 Fault output signal (FAULT)

Fault output signal indicates fault conditions of the driver (solenoid short circuits/not connected, CAN reference signal cable broken for  $4 \div 20$  mA input, spool position transducer cable broken, etc.). Fault presence corresponds to 0 VDC, normal working corresponds to 24 Vdc.

Fault status is not affected by the Enable input signal. Fault output signal can be used as digital output by software selection.

### 17.9 Remote pressure/force transducer input signal - only for SP, SF, SL


Analog remote pressure transducers or load cell can be directly connected to the driver.

Analog input signal is factory preset according to selected valve code, defaults are  $\pm 10$  VDC for standard and  $4 \div 20$  mA for /C option.

Input signal can be reconfigured via software selecting between voltage and current, within a maximum range of  $\pm 10$  VDC or  $\pm 20$  mA.

Refer to pressure/force transducer characteristics to select the transducer type according to specific application requirements (see table FX500).

## 18 TERMINAL BOARD OVERVIEW

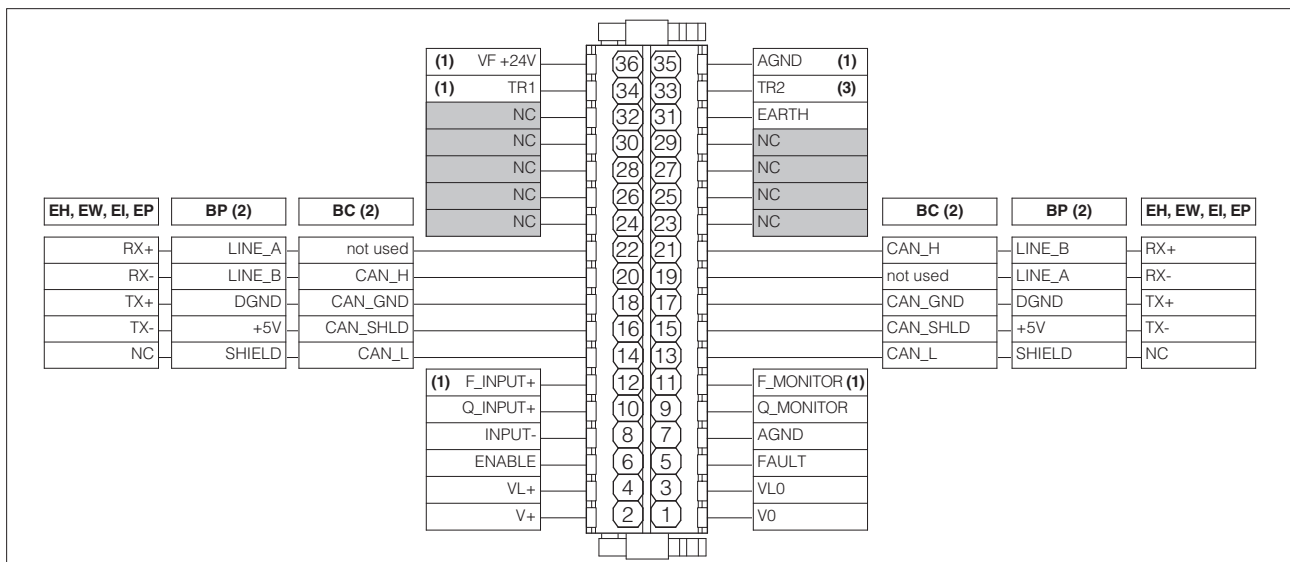

(1) Connections available only SP, SF, SL

(2) For BC and BP executions the fieldbus connections have an internal pass-through connection

(3) Connection available only SF

**19 ELECTRONIC CONNECTIONS**

**19.1 Main connections signals**

CABLE ENTRANCE	PIN	SIGNAL	TECHNICAL SPECIFICATIONS	NOTES
<b>A</b>	1	<b>V0</b>	Power supply 0 Vdc	Gnd - power supply
	2	<b>V+</b>	Power supply 24 Vdc	Input - power supply
	3	<b>VL0</b>	Power supply 0 Vdc for driver's logic and communication	Gnd - power supply
	4	<b>VL+</b>	Power supply 24 Vdc for driver's logic and communication	Input - power supply
	5	<b>FAULT</b>	Fault (0 Vdc) or normal working (24 Vdc), referred to VL0	Output - on/off signal
	6	<b>ENABLE</b>	Enable (24 Vdc) or disable (0 Vdc) the driver, referred to VL0	Input - on/off signal
	7	<b>AGND</b>	Analog ground	Gnd - analog signal
	8	<b>INPUT-</b>	Negative reference input signal for Q_INPUT+ and F_INPUT+	Input - analog signal
	9	<b>Q_MONITOR</b>	Flow monitor output signal: $\pm 10$ Vdc / $\pm 20$ mA maximum range, referred to AGND Defaults are: $\pm 10$ Vdc for standard and $4 \div 20$ mA for /I option	Output - analog signal <b>Software selectable</b>
	10	<b>Q_INPUT+</b>	Flow reference input signal: $\pm 10$ Vdc / $\pm 20$ mA maximum range Defaults are: $\pm 10$ Vdc for standard and $4 \div 20$ mA for /I option	Input - analog signal <b>Software selectable</b>
	11	<b>F_MONITOR</b>	Pressure/Force monitor output signal: $\pm 10$ Vdc / $\pm 20$ mA maximum range, referred to AGND (1) Defaults are: $\pm 10$ Vdc for standard and $4 \div 20$ mA for /I option	Output - analog signal <b>Software selectable</b>
	12	<b>F_INPUT+</b>	Pressure/Force reference input signal: $\pm 10$ Vdc / $\pm 20$ mA maximum range (1) Defaults are: $\pm 10$ Vdc for standard and $4 \div 20$ mA for /I option	Input - analog signal <b>Software selectable</b>
31	<b>EARTH</b>	Internally connected to driver housing		

(1) Available only for SP, SF, SL

**19.2 USB connector - M12 - 5 pin** always present

CABLE ENTRANCE	PIN	SIGNAL	TECHNICAL SPECIFICATIONS	Driver view	
<b>B</b>	1	<b>+5V_USB</b>	Power supply	<p>(female)</p>	
	2	<b>ID</b>	Identification		
	3	<b>GND_USB</b>	Signal zero data line		
	4	<b>D-</b>	Data line -		
	5	<b>D+</b>	Data line +		

**19.3 BC fieldbus execution connections**

CABLE ENTRANCE	PIN	SIGNAL	TECHNICAL SPECIFICATIONS
<b>C1</b>	14	<b>CAN_L</b>	Bus line (low)
	16	<b>CAN_SHLD</b>	Shield
	18	<b>CAN_GND</b>	Signal zero data line
	20	<b>CAN_H</b>	Bus line (high)
	22	<b>not used</b>	Pass-through connection (1)

CABLE ENTRANCE	PIN	SIGNAL	TECHNICAL SPECIFICATIONS
<b>C2</b>	13	<b>CAN_L</b>	Bus line (low)
	15	<b>CAN_SHLD</b>	Shield
	17	<b>CAN_GND</b>	Signal zero data line
	19	<b>not used</b>	Pass-through connection (1)
	21	<b>CAN_H</b>	Bus line (high)

(1) Pin 19 and 22 can be fed with external +5V supply of CAN interface

**19.4 BP fieldbus execution connections**

CABLE ENTRANCE	PIN	SIGNAL	TECHNICAL SPECIFICATIONS
<b>C1</b>	14	<b>SHIELD</b>	
	16	<b>+5V</b>	Power supply
	18	<b>DGND</b>	Data line and termination signal zero
	20	<b>LINE_B</b>	Bus line (low)
	22	<b>LINE_A</b>	Bus line (high)

CABLE ENTRANCE	PIN	SIGNAL	TECHNICAL SPECIFICATIONS
<b>C2</b>	13	<b>SHIELD</b>	
	15	<b>+5V</b>	Power supply
	17	<b>DGND</b>	Data line and termination signal zero
	19	<b>LINE_A</b>	Bus line (high)
	21	<b>LINE_B</b>	Bus line (low)

**19.5 EH, EW, EI, EP fieldbus execution connections**


CABLE ENTRANCE	PIN	SIGNAL	TECHNICAL SPECIFICATIONS
<b>C1</b> (input)	14	<b>NC</b>	do not connect
	16	<b>TX-</b>	Transmitter
	18	<b>TX+</b>	Transmitter
	20	<b>RX-</b>	Receiver
	22	<b>RX+</b>	Receiver

CABLE ENTRANCE	PIN	SIGNAL	TECHNICAL SPECIFICATIONS
<b>C2</b> (output)	13	<b>NC</b>	do not connect
	15	<b>TX-</b>	Transmitter
	17	<b>TX+</b>	Transmitter
	19	<b>RX-</b>	Receiver
	21	<b>RX+</b>	Receiver


**19.6 Remote pressure transducer connector - only for SP, SF, SL**

CABLE ENTRANCES	PIN	SIGNAL	TECHNICAL SPECIFICATIONS	NOTES	SP, SL - Single transducer (1)		SF - Double transducers (1)	
					Voltage	Current	Voltage	Current
<b>D1</b>	33	<b>TR2</b>	2nd signal transducer $\pm 10$ Vdc / $\pm 20$ mA maximum range	Input - analog signal <b>Software selectable</b>	/	/	Connect	Connect
	34	<b>TR1</b>	1st signal transducer $\pm 10$ Vdc / $\pm 20$ mA maximum range	Input - analog signal <b>Software selectable</b>	Connect	Connect	Connect	Connect
<b>D2</b>	35	<b>AGND</b>	Common gnd for transducer power and signals	Common gnd	Connect	/	Connect	/
	36	<b>VF +24V</b>	Power supply +24Vdc	Output - power supply	Connect	Connect	Connect	Connect

**E-ATRA remote pressure transducer connection - example**

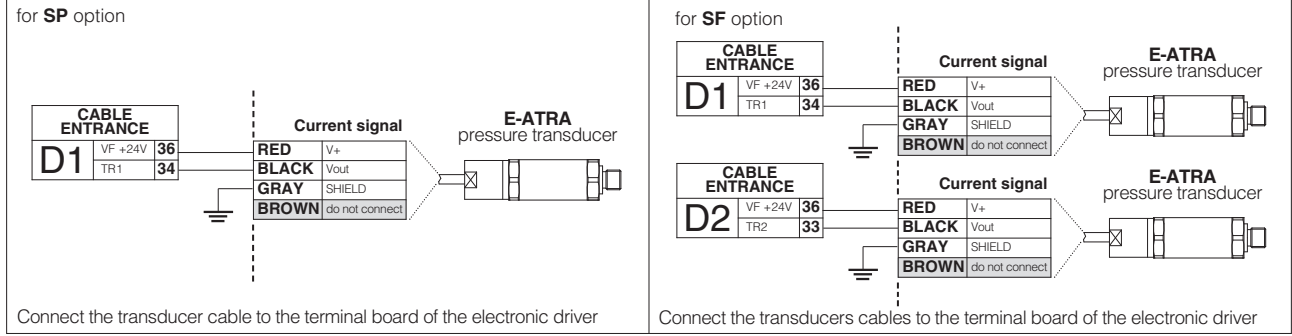


**20 POWER SUPPLY AND SIGNALS SPECIFICATIONS**

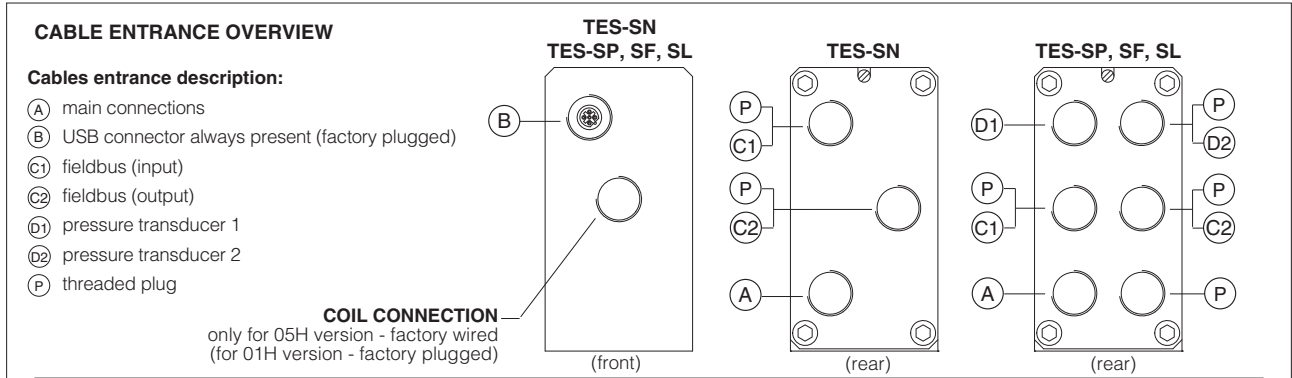


**TERMINAL BOARD AND FIELDBUS TERMINATOR**

Remove the 4 screws of driver's rear cover to access terminal board and fieldbus terminator

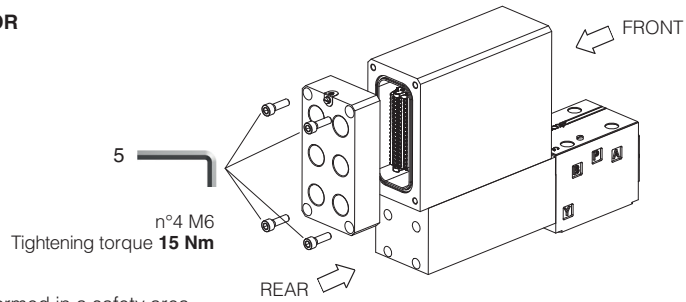

**WARNING:** the above operation must be performed in a safety area

Terminal board - see section 19

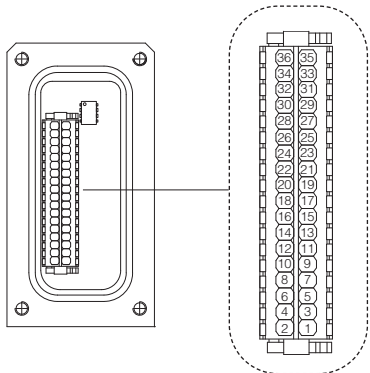

Fieldbus terminator only for BC and BP executions **(1)**


**BC - CANopen setting:**

Switch	Termination enabled
1	OFF
2	OFF
3	OFF
4	ON


**BP - PROFIBUS DP setting:**

Switch	Termination enabled
1	ON
2	ON
3	ON
4	OFF

**USB CONNECTOR**

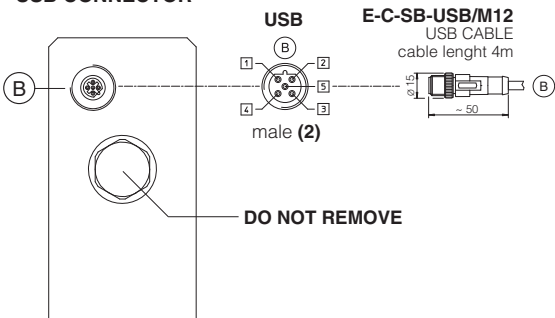




**METALLIC PROTECTION CAP** - supplied with the valves

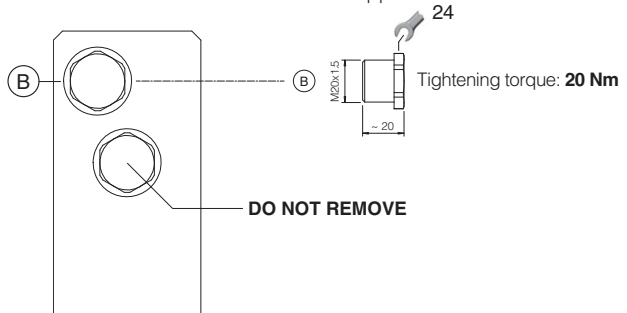




**(1)** Drivers with BC and BP fieldbus interface are delivered by default 'Not Terminated'. All switches are set OFF  
**(2)** Pin layout always referred to driver's view






### 20.1 Cable glands and threaded plug for TES-SN

Communication interfaces	To be ordered separately				Cable entrance overview	Notes
	Cable gland quantity	entrance	Threaded plug quantity	entrance		
NP	1	A	none	none		Cable entrance A is open for costumers Cable entrance P are factory plugged
BC, BP, EH, EW, EI, EP "via stub" connection	2	C1 A	1	C2		Cable entrance A, C1, C2 are open for costumers
BC, BP, EH, EW, EI, EP "daisy chain" connection	3	C1 C2 A	none	none		Cable entrance A, C1, C2 are open for costumers



### 20.2 Cable glands and threaded plug for TES-SP, SL - with one pressure transducer

Communication interfaces	To be ordered separately				Cable entrance overview	Notes
	Cable gland quantity	entrance	Threaded plug quantity	entrance		
NP	2	D1 A	none	none		Cable entrance A, D1 are open for costumers Cable entrance P are factory plugged
BC, BP, EH, EW, EI, EP "via stub" connection	3	D1 C1 A	1	C2		Cable entrance A, C1, C2, D1 are open for costumers Cable entrance P are factory plugged
BC, BP, EH, EW, EI, EP "daisy chain" connection	4	D1 C1 - C2 A	none	none		Cable entrance A, C1, C2, D1 are open for costumers Cable entrance P are factory plugged

### 20.3 Cable glands and threaded plug for TES-SF - with double pressure transducers

Communication interfaces	To be ordered separately				Cable entrance overview	Notes
	Cable gland quantity	entrance	Threaded plug quantity	entrance		
NP	3	D1 D2 A	none	none		Cable entrance A, D1, D2 are open for costumers Cable entrance P are factory plugged
BC, BP, EH, EW, EI, EP "via stub" connection	4	D1 - D2 C1 A	1	C2		Cable entrance A, C1, C2, D1, D2 are open for costumers Cable entrance P is factory plugged
BC, BP, EH, EW, EI, EP "daisy chain" connection	5	D1 - D2 C1 - C2 A	none	none		Cable entrance A, C1, C2, D1, D2 are open for costumers Cable entrance P is factory plugged

**21 FASTENING BOLTS AND SEALS**


	<p><b>DHZA</b></p> <p><b>Fastening bolts:</b> 4 socket head screws M5x50 class 12.9 Tightening torque = 8 Nm</p>	<p><b>DKZA</b></p> <p><b>Fastening bolts:</b> 4 socket head screws M6x40 class 12.9 Tightening torque = 15 Nm</p>
	<p><b>Seals:</b> 4 OR 108; Diameter of ports A, B, P, T: <math>\varnothing</math> 7,5 mm (max) 1 OR 2025 Diameter of port Y: <math>\varnothing</math> = 3,2 mm (only for /Y option)</p>	<p><b>Seals:</b> 5 OR 2050; Diameter of ports A, B, P, T: <math>\varnothing</math> 11,2 mm (max) 1 OR 108 Diameter of port Y: <math>\varnothing</math> = 5 mm (only for /Y option)</p>

**22 INSTALLATION DIMENSIONS FOR DHZA [mm]**

ISO 4401: 2005

Mounting surface: 4401-03-02-0-05 (see table P005)  
(for /Y surface: 4401-03-03-0-05 without port X)

Mass [kg]	
DHZA-TES-05	7,2
DHZA-TES-07	8,9

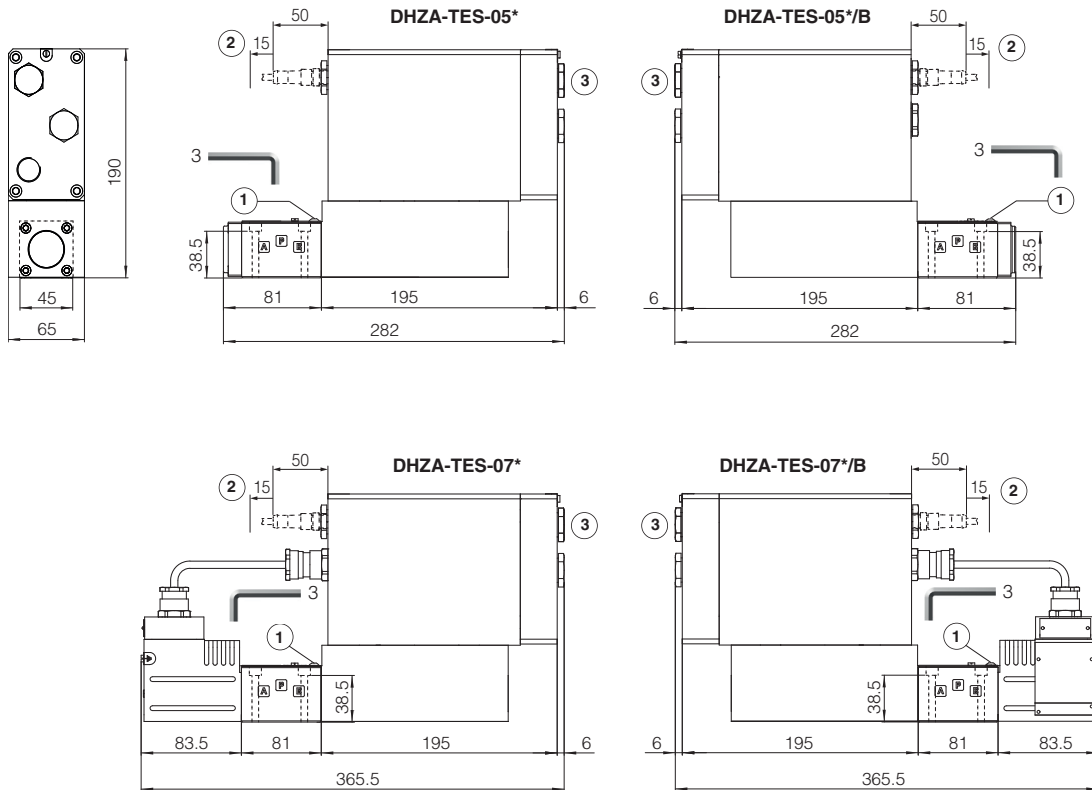


- ① = Air bleed off
- ② = Space to remove the connectors
- ③ = The dimensions of cable glands must be considered (see tech table **KX800**)

**23** INSTALLATION DIMENSIONS FOR DKZA [mm]

ISO 4401: 2005

Mounting surface: 4401-05-04-0-05 (see table P005)  
 (for /Y surface: 4401-05-05-0-05 without port X)

Mass [kg]	
DKZA-TES-15	9
DKZA-TES-17	10,7

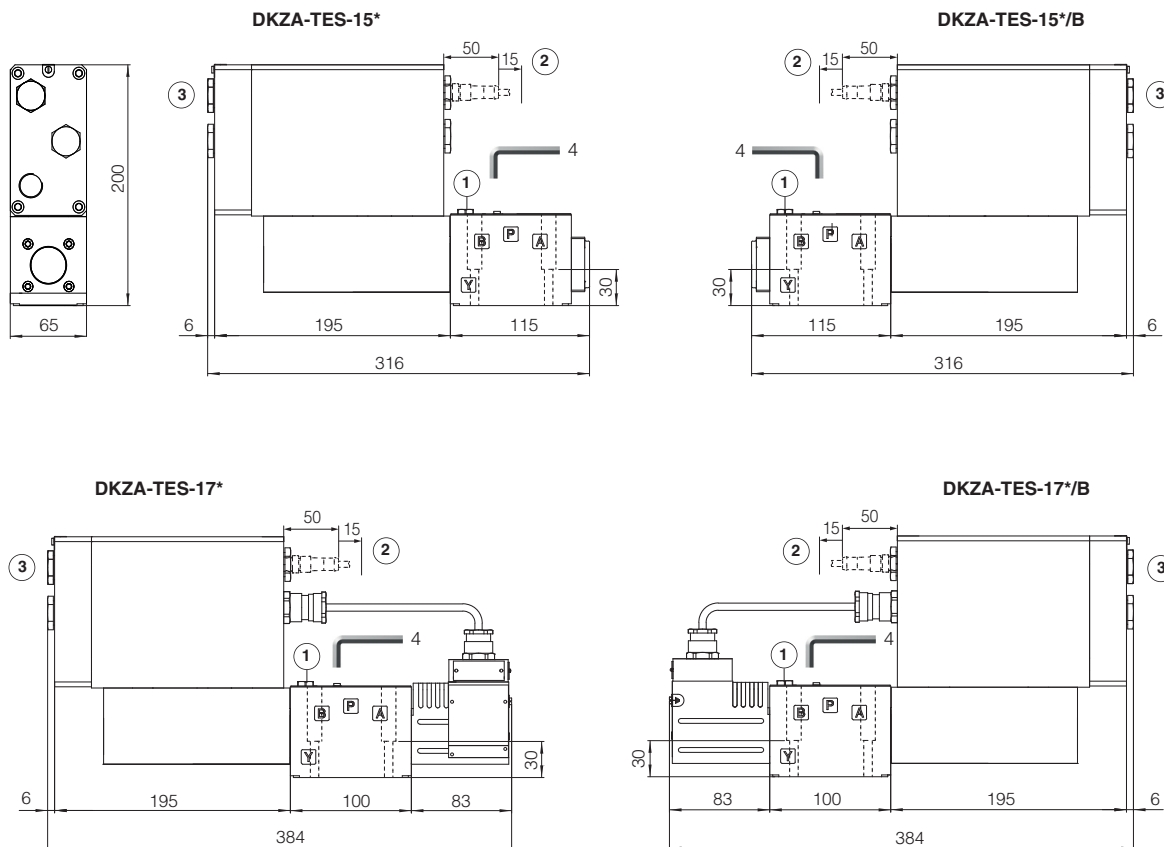

- ① = Air bleed off
- ② = Space to remove the connectors
- ③ = The dimensions of cable glands must be considered (see tech table **KX800**)

**24** RELATED DOCUMENTATION

<b>X010</b>	Basics for electrohydraulics in hazardous environments	<b>GS500</b>	Programming tools
<b>X020</b>	Summary of Atos ex-proof components certified to ATEX, IECEx, EAC, PESO	<b>GS510</b>	Fieldbus
<b>FX900</b>	Operating and maintenance norms for ex-proof proportional valves	<b>KX800</b>	Cable glands for ex-proof valves
<b>FX500</b>	Ex-proof for digital proportionals with P/Q control	<b>P005</b>	Mounting surfaces for electrohydraulic valves