


# Digital electronic E-BM-RES drivers

DIN-rail format, for proportional valves with integral pressure transducer

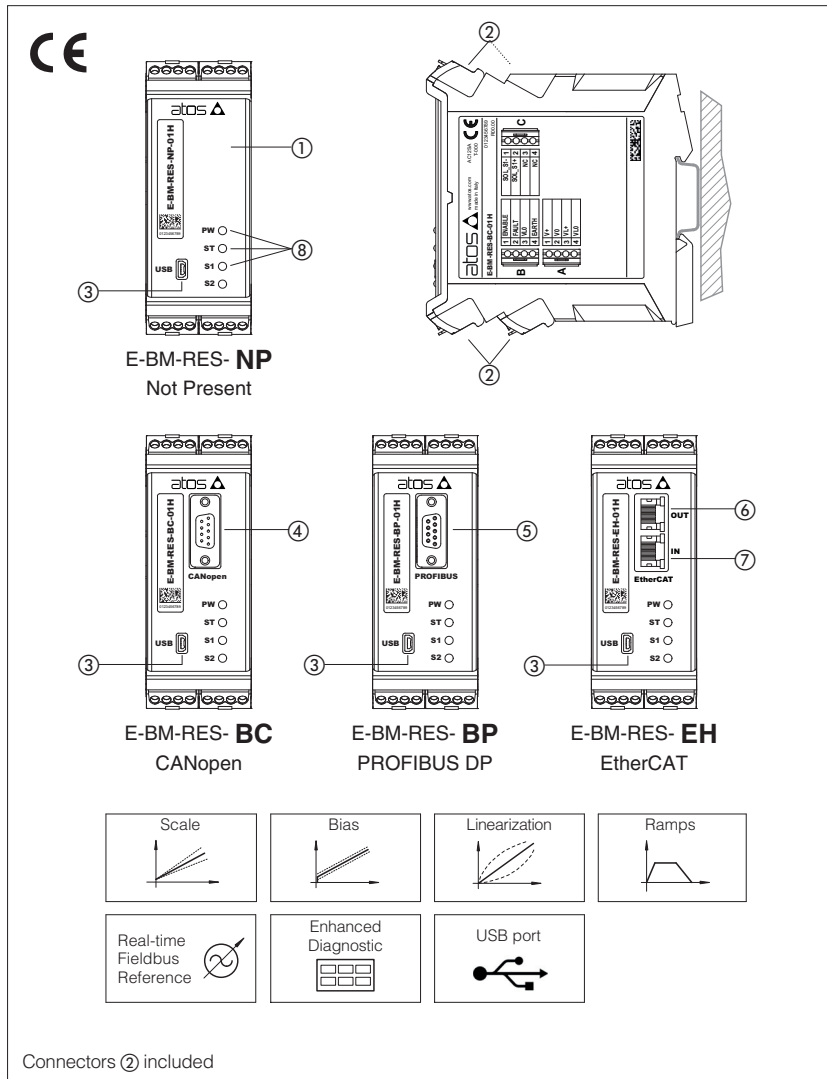

## E-BM-RES

Digital drivers ① control, in closed loop, the regulated pressure of direct and pilot operated proportional valves according to the electronic reference input signal.

E-BM-RES operate direct and pilot operated relief/reducing control valves with integral pressure transducer.

Atos PC software allows to customize the driver configuration to the specific application requirements.

### Electrical Features:

- 7 fast plug-in connectors ②
- Mini USB port ③ always present
- DB9 CANopen ④ and PROFIBUS DP ⑤ communication connector
- RJ45 EtherCAT communication connectors ⑥ output and ⑦ input
- 3 leds for diagnostics ⑧ (see 4.1)
- Pressure transducer input signal  $4 \div 20$  mA
- $\pm 5$  Vdc output supply for external reference potentiometer
- Electrical protection against reverse polarity of power supply
- Operating temperature range:  $-20 \div +60$  °C
- Plastic box with IP20 protection degree and standard DIN-rail mounting
- CE mark according to EMC directive

### Software Features:

- Intuitive graphic interface
- Setting of valve's functional parameters: bias, scale, ramps, dither, PID gains
- 4 factory pre-set dynamic response setting to match different hydraulic conditions (see 8.1)
- Linearization function for hydraulic regulation
- Complete diagnostics of driver status
- Internal oscilloscope function
- In field firmware update through USB port

### Fieldbus Features:

- Valve direct communication with machine control unit for digital reference, diagnostics and settings
- Fieldbus execution allow to operate the valves via fieldbus or via analog signals available on the connectors (see 4.2)

## 1 MODEL CODE

<b>E-BM</b>	-	<b>RES</b>	-	<b>NP</b>	-	<b>01H</b>	/	<b>*</b>		<b>*</b>	/	<b>*</b>
Off-board electronic driver in DIN rail format												
<b>RES</b> = digital full driver, for valves with pressure transducer												
<b>Fieldbus interface</b> - USB port always present: <b>NP</b> = Not Present <b>BC</b> = CANopen <b>BP</b> = PROFIBUS DP <b>EH</b> = EtherCAT												
									<b>Options:</b> <b>A</b> = max current limitation for Ex-proof valves <b>I</b> = current reference input and monitor $4 \div 20$ mA (omit for voltage reference and monitor input $0 \div 10$ Vdc)			
									<b>01H</b> = for single solenoid proportional valves			
											Set code (see section 5)	
											Series number	

## 2 VALVES RANGE


Valves	Relief			Reducing			Compensator
Industrial Tech table	<b>RZMO</b> FS010, FS067	<b>AGMZO</b> FS040	-	<b>RZGO</b> FS020, FS075	<b>AGRCZO</b> FS055	-	-
Ex-proof Tech table	<b>RZMA</b> FX035	<b>AGMZA</b> FX035	<b>LIMZA</b> FX325	<b>RZGA</b> FX065	<b>AGRCZA</b> FX065	<b>LIRZA</b> FX325	<b>LICZA</b> FX325

### 3 MAIN CHARACTERISTICS

Power supply (see 6.1, 6.4)	Nominal : +24 V <sub>DC</sub> Rectified and filtered : V <sub>RMS</sub> = 20 ÷ 32 V <sub>MAX</sub> (ripple max 10 % V <sub>PP</sub> )			
Max power consumption	50 W			
Current supplied to solenoids	I <sub>MAX</sub> = 2.7 A with +24 V <sub>DC</sub> power supply to drive standard proportional valves (3,2 Ω solenoid) I <sub>MAX</sub> = 2.5 A with +24 V <sub>DC</sub> power supply to drive ex-proof proportional valves (3,2 Ω solenoid) for /A option			
Analog input signals (see 6.2)	Voltage: maximum range ±10 V <sub>DC</sub> Input impedance: R <sub>i</sub> > 50 kΩ Current: maximum range ±20 mA Input impedance: R <sub>i</sub> = 500 Ω			
Monitor output (see 6.3)	Voltage: maximum range 0 ÷ 10 V <sub>DC</sub> @ max 5 mA Current: maximum range 0 ÷ 20 mA @ max 500 Ω load resistance			
Enable input (see 6.5)	Range : 0 ÷ 9 V <sub>DC</sub> (OFF state), 15 ÷ 24 V <sub>DC</sub> (ON state), 9 ÷ 15 V <sub>DC</sub> (not accepted); Input impedance: R <sub>i</sub> > 87 kΩ			
Output supply (see 6.8)	±5 V <sub>DC</sub> @ max 10 mA : output supply for external potentiometer			
Fault output (see 6.6)	Output range : 0 ÷ 24 V <sub>DC</sub> (ON state ≡ VL+ [logic power supply] ; OFF state ≡ 0 V) @ max 50 mA; external negative voltage not allowed (e.g. due to inductive loads)			
Pressure transducer power supply	+24V <sub>DC</sub> @ max 100 mA (E-ATR-8 see tech table <b>GS465</b> ; E-ATRA-7 for ex-proof, see tech table <b>GX800</b> )			
Alarms	Solenoid not connected/short circuit, cable break with current reference signal, over/under temperature, power supplies level, pressure transducer failure, alarms history storage function			
Format	Plastic box ; IP20 protection degree ; L 35 - H 7,5 mm DIN-rail mounting as per EN60715			
Operating temperature	-20 ÷ +60 °C (storage -25 ÷ +85 °C)			
Mass	Approx. 330 g			
Additional characteristics	Short circuit protection of solenoid current supply; current control by P.I.D. with rapid solenoid switching; protection against reverse polarity of power supply			
Compliance	CE according to EMC directive 2014/30/EU (Immunity: EN 61000-6-2; Emission: EN 61000-6-3) RoHS Directive 2011/65/EU as last update by 2015/863/EU REACH Regulation (EC) n°1907/2006			
Communication interface	USB Atos ASCII coding	CANopen EN50325-4 + DS408	PROFIBUS DP EN50170-2/IEC61158	EtherCAT IEC61158
Communication physical layer	not insulated USB 2.0 + USB OTG	optical insulated CAN ISO11898	optical insulated RS485	Fast Ethernet 100 Base TX
Recommended wiring cable	LiYCY shielded cables: 0,5 mm <sup>2</sup> max 50 m for logic - 1,5 mm <sup>2</sup> max 50 m for power supply and solenoids			
Max conductor size (see 10)	2,5 mm <sup>2</sup>			

**Note:** a maximum time of 500 ms (depending on communication type) have be considered between the driver energizing with the 24 V<sub>DC</sub> power supply and when the valve is ready to operate. During this time the current to the valve coils is switched to zero.


### 4 CONNECTIONS AND LEDS

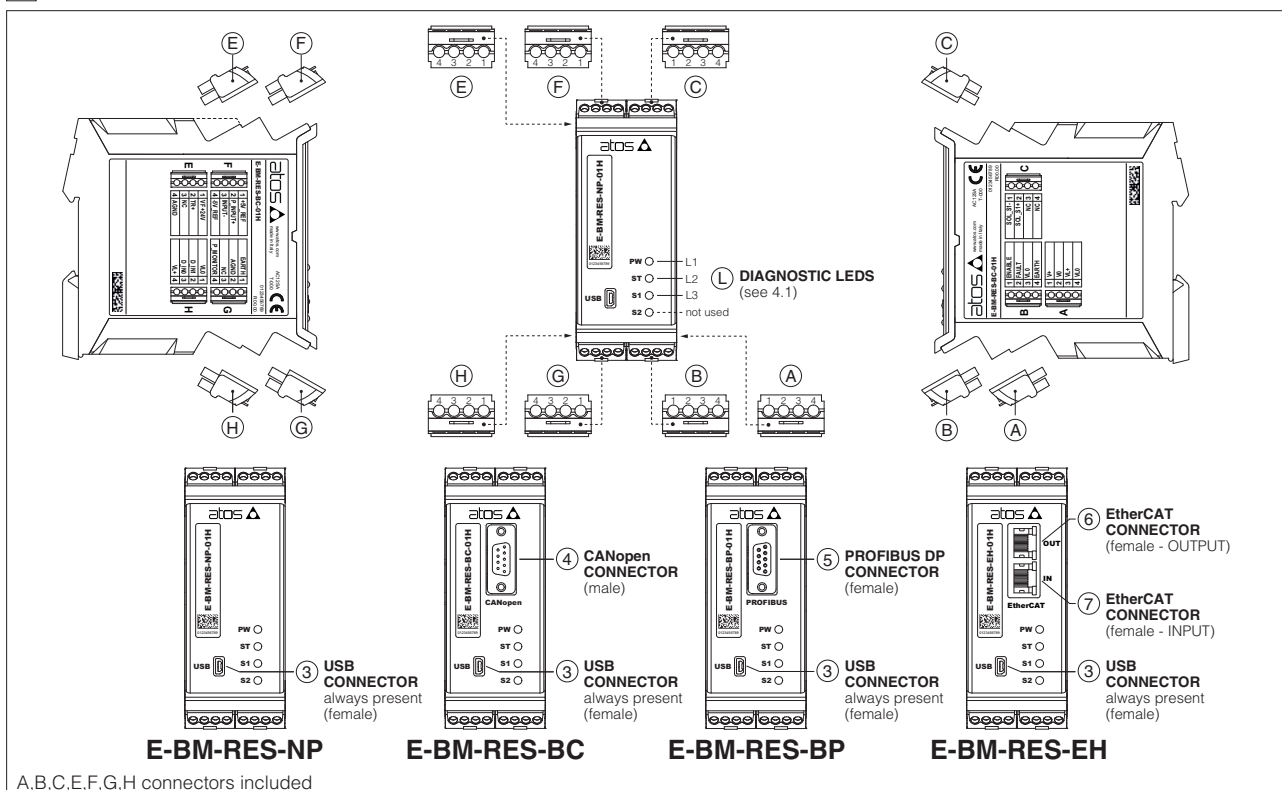

#### 4.1 Diagnostic LEDs (L)

Three leds show driver operative conditions for immediate basic diagnostics. Please refer to the driver user manual for detailed information.


LED	COLOR	FUNCTION	FLASH RATE	DESCRIPTION
L1	GREEN	PW	OFF	Power supply OFF
			ON	Power supply ON
L2	GREEN	ST	OFF	Fault present
			ON	No fault
L3	YELLOW	S1	OFF	PWM command OFF
			ON	PWM command ON




## 4.2 Connectors - 4 pin

CONNECTOR	PIN	SIGNAL	TECHNICAL SPECIFICATIONS	NOTES
<b>A</b>	A1	<b>V+</b>	Power supply 24 Vdc (see 6.1)	Input - power supply
	A2	<b>V0</b>	Power supply 0 Vdc (see 6.1)	Gnd - power supply
	A3	<b>VL+</b>	Power supply 24 Vdc for driver's logic and communication (see 6.4)	Input - power supply
	A4	<b>VL0</b>	Power supply 0 Vdc for driver's logic and communication (see 6.4)	Gnd - power supply
<b>B</b>	B1	<b>ENABLE</b>	Enable (24 Vdc) or disable (0 Vdc) the driver, referred to VL0 (see 6.5)	Input - on/off signal
	B2	<b>FAULT</b>	Fault (0 Vdc) or normal working (24 Vdc), referred to VL0 (see 6.6)	Output - on/off signal
	B3	<b>VL0</b>	Ground for ENABLE and FAULT	Gnd - digital signals
	B4	<b>EARTH</b>	Connect to system ground	
<b>C</b>	C1	<b>SOL_S1-</b>	Negative current to solenoid S1	Output - power PWM
	C2	<b>SOL_S1+</b>	Positive current to solenoid S1	Output - power PWM
	C3	<b>NC</b>	Do not connect	
	C4	<b>NC</b>	Do not connect	
<b>E</b>	E1	<b>VF +24V</b>	Power supply +24 Vdc	Output - power supply
	E2	<b>TR+</b>	Positive pressure transducer input signal: $\pm 20$ mA maximum range (see 6.7) Default is $4 \div 20$ mA	Input - analog signal <b>Software selectable</b>
	E3	<b>NC</b>	Do not connect	
	E4	<b>AGND</b>	Common gnd for signals and external potentiometer	
<b>F</b>	F1	<b>+5V_REF</b>	External potentiometer power supply +5 Vdc @ 10mA (see 6.8)	Output - power supply
	F2	<b>P_INPUT+</b>	Positive pressure reference input signal: $\pm 10$ Vdc / $\pm 20$ mA maximum range (see 6.2) Defaults are $0 \div 10$ Vdc for standard and $4 \div 20$ mA for /I option	Input - analog signal <b>Software selectable</b>
	F3	<b>INPUT-</b>	Negative pressure reference input signal for P_INPUT+	Input - analog signal
	F4	<b>-5V_REF</b>	External potentiometer power supply -5 Vdc @ 10mA (see 6.8)	Output - power supply
<b>G</b>	G1	<b>EARTH</b>	Connect to system ground	
	G2	<b>AGND</b>	Analog ground for monitor and external potentiometer	Gnd - analog signal
	G3	<b>NC</b>	Do not connect	
	G4	<b>P_MONITOR</b>	Pressure monitor output signal: $0 \div 10$ Vdc / $0 \div 20$ mA maximum range (see 6.3) Default are $0 \div 10$ Vdc for standard and $4 \div 20$ mA for /I option	Output - analog signal <b>Software selectable</b>
<b>H</b>	H1	<b>VL0</b>	Power supply 0 Vdc for digital input (see 6.4)	Gnd - power supply
	H2	<b>D_IN1</b>	Pressure PID selection, referred to VL0 (see 6.9)	Input - on/off signal
	H3	<b>D_IN0</b>	Pressure PID selection, referred to VL0 (see 6.9)	Input - on/off signal
	H4	<b>VL+</b>	Power supply 24 Vdc for digital input (see 6.4)	Output - power supply


### Pressure transducer connections

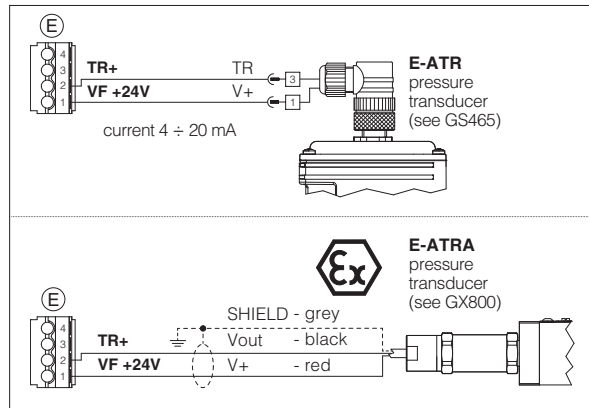

### Coil connection

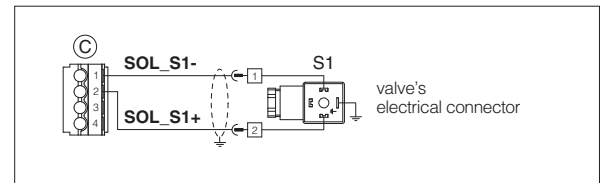

### Potentiometer connection

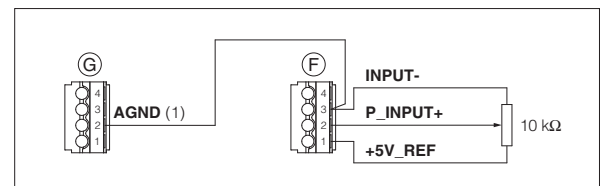

(1) As alternative the AGND on pin E4 can be used

## 4.3 Communication connectors ③ - ④ - ⑤ - ⑥ - ⑦

③ USB connector - Mini USB type B always present		
PIN	SIGNAL	TECHNICAL SPECIFICATION (1)
1	<b>+5V_USB</b>	Power supply
2	<b>D-</b>	Data line -
3	<b>D+</b>	Data line +
4	<b>ID</b>	Identification
5	<b>GND_USB</b>	Signal zero data line

⑤ BP fieldbus execution, connector - DB9 - 9 pin		
PIN	SIGNAL	TECHNICAL SPECIFICATION (1)
1	<b>SHIELD</b>	
3	<b>LINE-B</b>	Bus line (low)
5	<b>DGND</b>	Data line and termination signal zero
6	<b>+5V</b>	Termination supply signal
8	<b>LINE-A</b>	Bus line (high)

(1) shield connection on connector's housing is recommended

④ BC fieldbus execution, connector - DB9 - 9 pin		
PIN	SIGNAL	TECHNICAL SPECIFICATION (1)
2	<b>CAN_L</b>	Bus line (low)
3	<b>CAN_GND</b>	Signal zero data line
5	<b>CAN_SHLD</b>	Shield
7	<b>CAN_H</b>	Bus line (high)

⑥ ⑦ EH fieldbus execution, connector - RJ45 - 8 pin		
PIN	SIGNAL	TECHNICAL SPECIFICATION (1)
1	<b>TX+</b>	Transmitter - white/orange
2	<b>RX+</b>	Receiver - white/green
3	<b>TX-</b>	Transmitter - orange
6	<b>RX-</b>	Receiver - green

## 5 SET CODE

The basic calibration of electronic driver is factory preset, according to the proportional valve to be coupled. These pre-calibrations are identified by the set code at the end of driver's model code (see section [1]). For correct set code selection, please include in the driver order also the complete code of the coupled proportional valve. For further information about set code, please contact Atos technical office.

## 6 POWER SUPPLY AND SIGNALS SPECIFICATIONS

Atos digital drivers are CE marked according to the applicable directives (e.g. Immunity and Emission EMC Directive). Installation, wirings and start-up procedures must be performed according to the general prescriptions shown in the user manuals included in the E-SW-SETUP programming software. Generic electrical output signals of the valve (e.g. fault or monitor signals) must not be directly used to activate safety functions, like to switch-ON/OFF the machine's safety components, as prescribed by the European standards (Safety requirements of fluid technology systems and components-hydraulics, ISO 4413).

### 6.1 Power supply (V+ and V0)

The power supply must be appropriately stabilized or rectified and filtered: apply at least a 10000  $\mu$ F/40 V capacitance to single phase rectifiers or a 4700  $\mu$ F/40 V capacitance to three phase rectifiers. In case of double power supply see 6.4.  
A safety fuse is required in series to each power supply: 2.5 A time lag fuse.

### 6.2 Pressure reference input signal (P\_INPUT+)

The driver controls in closed loop the current to the valve pressure proportionally to the external reference input signal.  
Reference input signal is factory preset according to selected valve code, defaults are 0  $\div$  10 V<sub>DC</sub> for standard and 4  $\div$  20 mA for /I option.  
Input signal can be reconfigured via software selecting between voltage and current, within a maximum range of  $\pm$ 10 V<sub>DC</sub> or  $\pm$  20 mA.  
Drivers with fieldbus interface (BC, BP, EH) can be software set to receive reference signal directly by the machine control unit (fieldbus reference).  
Analog reference input signal can be used as on-off commands with input range 0  $\div$  24V<sub>DC</sub>.

### 6.3 Pressure monitor output signal (P\_MONITOR)

The driver generates an analog output signal proportional to the actual pressure of the valve; the monitor output signal can be software set to show other signals available in the driver (e.g. analog reference, fieldbus reference).  
Monitor output signal is factory preset according to selected valve code, defaults settings are 0  $\div$  10 V<sub>DC</sub> for standard and 4  $\div$  20 mA for /I option.  
Output signal can be reconfigured via software selecting between voltage and current, within a maximum range of 0  $\div$  10 V<sub>DC</sub> or 0  $\div$  20 mA.

### 6.4 Power supply for driver's logic and communication (VL+ and VLO)

The power supply for driver's logic and communication must be appropriately stabilized or rectified and filtered: apply at least a 10000  $\mu$ F/40 V capacitance to single phase rectifiers or a 4700  $\mu$ F/40 V capacitance to three phase rectifiers.  
The separate power supply for driver's logic on pin A3 and A4, allow to remove solenoid power supply from pin A1 and A2 maintaining active the diagnostics, USB and fieldbus communications.  
A safety fuse is required in series to each driver's logic and communication power supply: 500 mA fast fuse.

### 6.5 Enable input signal (ENABLE)

To enable the driver, supply 24 V<sub>DC</sub> on pin B1: Enable input signal allows to enable/disable the current supply to the solenoid, without removing the electrical power supply to the driver; it is used to active the communication and the other driver functions when the valve must be disabled for safety reasons. This condition does not comply with European Norms EN13849-1 (ex EN954-1).

### 6.6 Fault output signal (FAULT)

Fault output signal indicates fault conditions of the driver (solenoid short circuits/not connected, reference signal broken for 4  $\div$  20 mA input, etc.).  
Fault presence corresponds to 0 V<sub>DC</sub>, normal working corresponds to 24 V<sub>DC</sub>.  
Fault status is not affected by the Enable input signal.

### 6.7 Pressure transducer integrated to the valve, input signal (TR+)

Analog pressure transducer integrated to the valve, has to be directly connected to the driver.  
Analog input signal is factory preset according to selected driver code, default is 4  $\div$  20 mA.  
Input signal can be reconfigured via software, within a maximum range of  $\pm$  20 mA.

### 6.8 Output supply for external potentiometer ( $\pm$ 5V\_REF) - not available for EH version

The reference analog signal can be generated by one external potentiometer directly connected to the driver, using the  $\pm$ 5 V<sub>DC</sub> supply output available at pin F1 and F4.

Note: using an external potentiometer, the reference input signal must be set via software at 0  $\div$  5 V<sub>DC</sub> (default 0  $\div$  10 V<sub>DC</sub>, see 6.2)

### 6.9 PID selection (D\_IN0 and D\_IN1)

Two on-off input signals are available on the pin H2 and H3 to select one of the four pressure PID parameters setting, stored into the driver.  
Supply a 24 V<sub>DC</sub> or a 0 V<sub>DC</sub> on pin H2 and/or pin H3, to select one of the PID settings as indicated by binary code table at side. Gray code can be selected by software.  
Refer to dynamic response for function description (see 8.1).

PID SET SELECTION				
PIN	SET 1	SET 2	SET 3	SET 4
H2	0	24 V <sub>DC</sub>	0	24 V <sub>DC</sub>
H3	0	0	24 V <sub>DC</sub>	24 V <sub>DC</sub>

### 6.10 Possible combined options: /AI

## 7 VALVE SETTINGS AND PROGRAMMING TOOLS - see tech. table GS500


Free downloadable software for PC allows to set all valve functional parameters and to access complete diagnostic information of digital drivers via USB service port.  
Atos E-SW-SETUP PC software supports all Atos digital valve drivers and it is available at [www.atos.com](http://www.atos.com) in MyAtos area.



**WARNING: drivers USB port is not isolated!** For E-C-SB-USB/BM cable, the use of E-A-SB-USB/OPT isolator adapter is highly recommended for PC protection

**Note:** Bluetooth connection is not available for E-BM-RES drivers

### USB connection

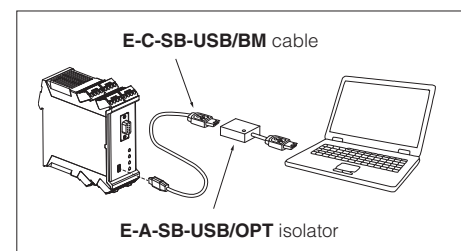

## 8 MAIN SOFTWARE PARAMETER SETTINGS

The following is a brief description of the main settings and features of digital drivers. For a detailed descriptions of available settings, wirings and installation procedures, please refer to the user manual included in the E-SW-SETUP programming software:

### E-MAN-BM-RES - user manual for E-BM-RES

#### 8.1 Smart tuning


Smart tuning allows to adjust the valve dynamic response in order to match different hydraulic conditions and performance requirements.

The valve is provided with 3 factory settings for the pressure control:

- **dynamic** fast response time for best dynamic performances. Default factory setting for pressure valves
- **balanced** average response time suitable for major applications
- **smooth** attenuated response time for slow regulation without overshoots

Smart tuning setting can be switched from Dynamic (default) to Balanced or Smooth via software or fieldbus; if requested, performances can be further customized directly tuning each single control parameter.

Below indications have to be considered as a general guideline, being affected by hydraulic circuit stiffness, working flow and dead volume.

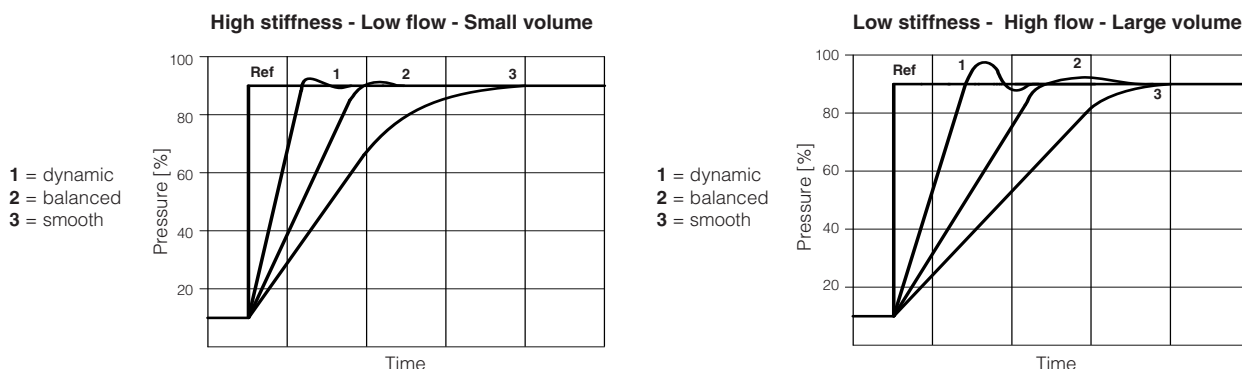

#### 8.2 Pressure transducer failure

This function is available only for pressure transducer input configured in current as  $4 \div 20$  mA.

In case of pressure transducer failure, the valve's reaction can be configured through Atos E-SW-SETUP software to:

- cut off the current to solenoid, therefore the regulated pressure will be reduced to minimum value (default setting)
- automatically switch the pressure control from closed loop (dynamic, balanced, smooth) to open loop, to let the valve to temporarily operate with reduced regulation accuracy

#### 8.3 Scale

Scale function allows to set the maximum current supplied to the solenoid, corresponding to the max pressure valve regulation, at maximum reference signal value.

This regulation allows to adapt the maximum current supplied from the driver to the specific nominal current of the pressure proportional valves to which the driver is coupled; it is also useful to reduce the maximum valve regulation in front of maximum reference signal.

#### 8.4 Bias and Threshold

Pressure proportional valves may be provided with a dead band in the hydraulic regulation corresponding to their switch-off status.

This dead band discontinuity in the pressure valve's regulation can be compensated by activating the Bias function, which adds a fixed preset Bias value to the reference signal (analog or fieldbus external input).

The Bias function is activated when the reference signal overcomes the Threshold value, preset into the driver.

The Bias setting allows to calibrate the Bias current to the specific pressure proportional valve to which the driver is coupled.

The Threshold setting is useful to avoid undesired valve regulation at zero reference signal when electric noise is present on the analog input signal: smaller threshold reduces the reference signal dead band, greater values are less affected by electric noise presence.

If fieldbus reference signal is active (see 6.2), threshold should be set to zero.

Refer to the programming manuals for a detailed description of other software selectable Bias functions.

#### 8.5 Ramps

The ramp generator allows to convert sudden change of electronic reference signal into smooth time-dependent increasing/decreasing of the current supplied to the solenoid.

Different ramp mode can be set:

- single ramp for any reference variation
- two ramps for increasing and for decreasing reference variations


Ramp generator is useful for application where smooth hydraulic actuation is necessary to avoid machine vibration and shocks.

If the pressure proportional valve is driven by a closed loop controller, the ramps can lead to unstable behaviour, for these applications ramp function can be software disabled (default setting).


#### 8.6 Linearization - E-SW-SETUP level 2 functionality

Linearization function allows to set the relation between the reference input signal and the controlled valve's pressure regulation. Linearization is useful for applications where it is required to linearize the valve's pressure regulation in a defined working condition.


#### 8.3, 8.4 - Scale, Bias & Threshold

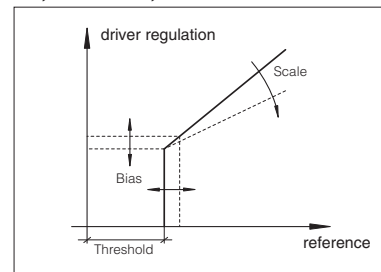

#### 8.5 - Ramps


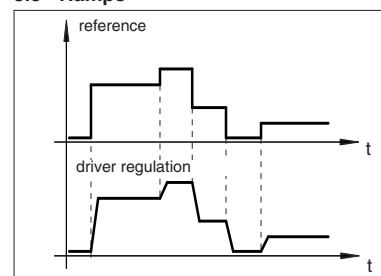


#### 8.6 - Linearization

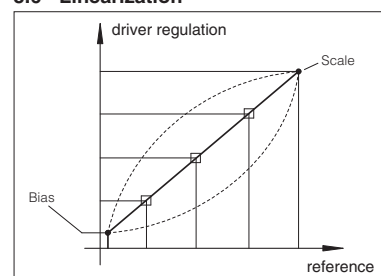

## 9 OVERALL DIMENSIONS [mm]

overall dimension with assembled connectors

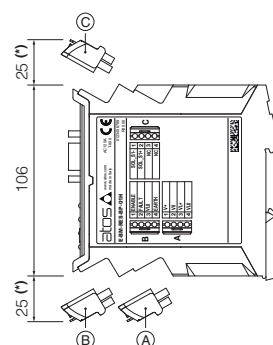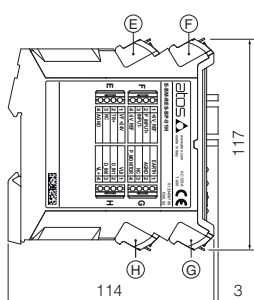

DIN rail dimensions




A, B, C, E, F, G, H connectors included

(\*) Space to remove the connectors

## 10 INSTALLATION

### To wire cables in the connectors:


1. insert cable into the termination
2. turn screw with a screwdriver

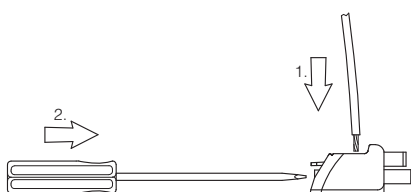

**Note:** max conductor size: 2,5 mm<sup>2</sup>  
tightening torque: 0,4 ÷ 0,6 Nm



### To unlock the driver from the DIN rail:

1. pull down the locking slide with a screwdriver
2. rotate up the driver

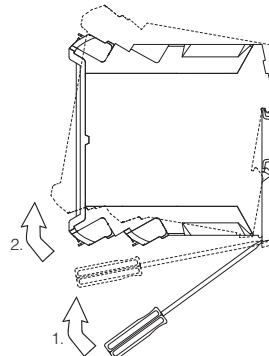



### To extract the connectors:

1. push lever
2. pull connector



### To insert the connectors:

1. push the connector in its slot



**Note:** all connectors are supplied with a mechanical coding. This feature ensures a unique insertion of each connector in the own slot (eg. connector A can not be inserted into connector slot of B, C, E, F, G, H)