


## Fieldbus features

BC (CANopen), BP (PROFIBUS DP), EH (EtherCAT),  
EW (POWERLINK), EI (EtherNet/IP), EP (PROFINET RT/IRT)

Typical CANopen or PROFIBUS DP fieldbus network

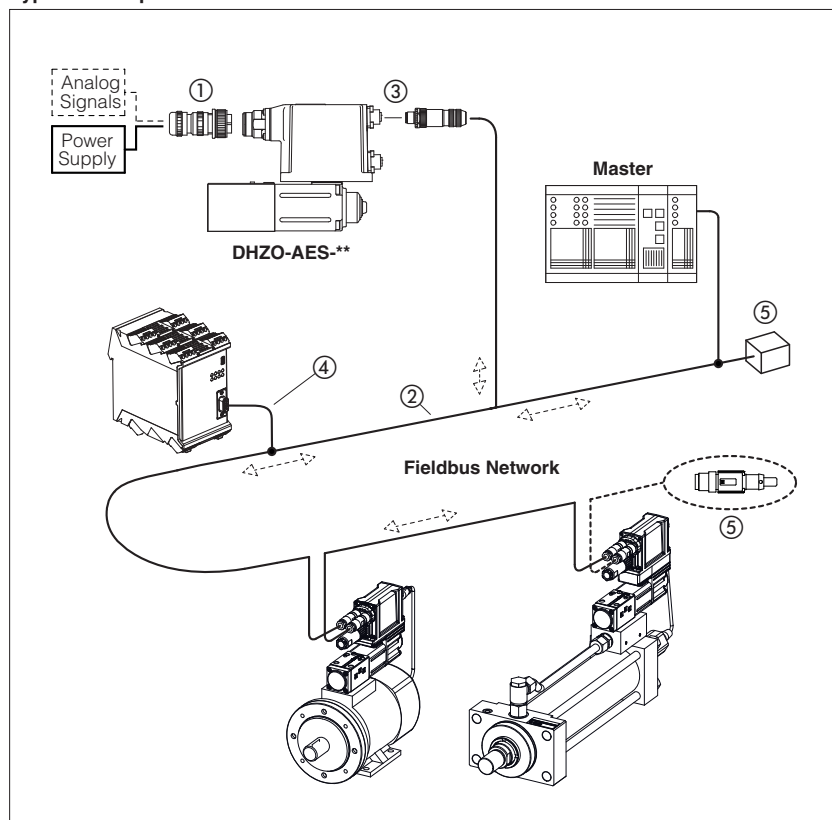

Fieldbus communication interfaces are available for valve drivers, pump drivers, axis controls and servopump drives, granting several plus:


- more information available for machine operation to enhance its performances
- improved accuracy and robustness of digital transmitted information
- costs reduction due to simpler and standardized wiring solutions
- costs reduction due to fast and simple installation and maintenance
- direct integration into machine's communication networks

These executions allow to operate valve drivers, pump drivers, axis controls and servopump drives through fieldbus or using the analog signals on main connector ①.

### Fieldbus distributed-control

Fieldbus communication allows to share all the available information of the valve drivers, pump drivers, axis controls and servopump drives (reference, monitor, etc). This distributed-control design allows to implement powerful machines functionalities for tuning, diagnostic, maintenance, etc.

Typical EtherCAT, POWERLINK, EtherNet/IP or PROFINET RT/IRT fieldbus network

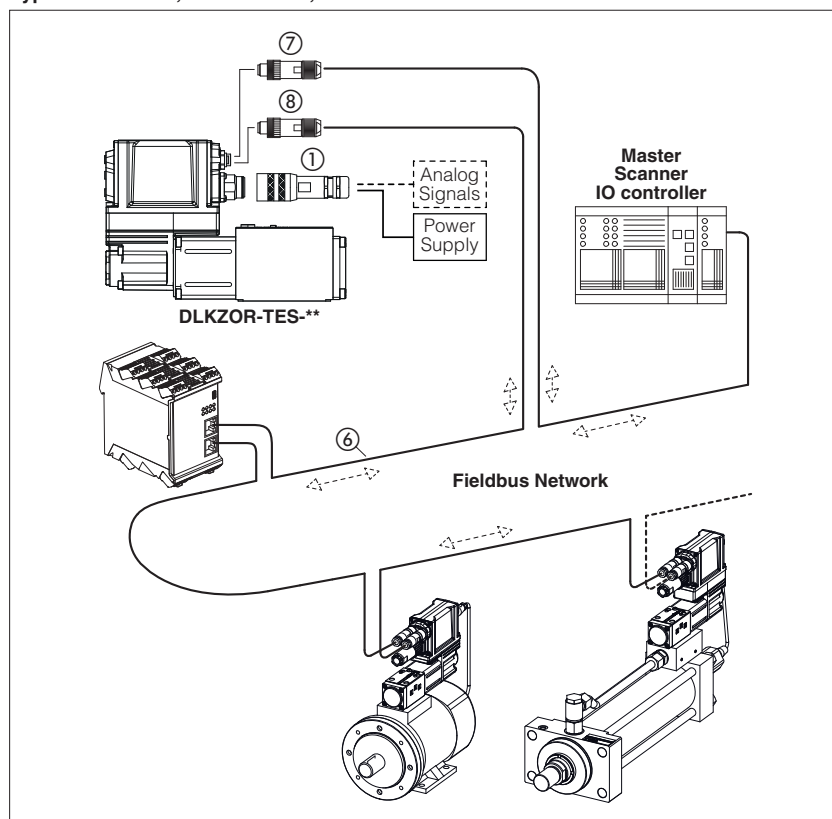

**CANopen and PROFIBUS DP** networks consist of a common cable (2 twisted wire, ②) for digital communication: several devices (node ③) can be connected to this main cable by means of short cable branches ④.

The two endpoints of the main cable must be terminated with specific devices (terminator, ⑤) to dissipate the communication signal's energy thus preventing interferences and degradations of fieldbus transmission.

**EtherCAT, POWERLINK, EtherNet/IP and PROFINET RT/IRT** networks consist in a Ethernet common cable (4 twisted wire, ⑥) for digital communication. All slave, adapter and IO device have always the double connector for signal input ⑦ and signal output ⑧.

The main Ethernet cable starting from the master, scanner and IO controller has to be connected to the slave, adapter and IO device input connector.

The slave, adapter and IO device output connector has to be connected to the next slave, adapter and IO device input connector.

## 1 CANopen features for BC executions

### Physical

Serial input format	Industrial field-bus with optical insulation type CAN-Bus ISO11898
Transmission rate	Transmission rates from 10 Kbit/s to 1 Mbit/s
Max node	32 per segment without repeater; 127 per segment with repeater

### Communication Protocol

Data Link Layer	DS301 V4.2.0 - based on CAN standard frame with 11-bit identifier
Device Profile	DS408 - Fluid Power Technology (EN50325-4) <b>(1)</b>
Device type	Slave

### Startup and configuration - as per DS301 + DSP305

Boot up process	Minimum boot-up
Node setting	LSS (Layer Setting Services) <b>(1)</b> SDO E-SW, Z-SW and S-SW programming software
Baudrate setting	LSS (Layer Setting Services) <b>(1)</b> SDO
Baudrate	10 / 20 / 50 (default) / 125 / 250 / 500 / 1000Kbit/s

### Fieldbus communication diagnostic - as per DS301

Device Error	Emergency
Network Error	Node Guarding Heartbeat

### Real-time communication - as per DS301 + DS408

RPDO	4 mappable PDOs to the valve drivers and pump drivers: AES, BM-AES, TES, BM-TEZ, LES, BM-LES, RES, BM-RES, PES 4 mappable PDOs to the axis controls: TEZ, BM-TEZ, LEZ, BM-LEZ, BM-KZ 4 mappable PDOs to the servopump drives: D-MP
TPDO	4 mappable PDOs from the valve drivers and pump drivers: AES, BM-AES, TES, BM-TEZ, LES, BM-LES, RES, BM-RES, PES 4 mappable PDOs from the controllers: TEZ, BM-TEZ, LEZ, BM-LEZ, BM-KZ 4 mappable PDOs from the servopump drives: D-MP
R(T)PDO types	Event Triggered, Remotely requested, Sync(cyclic) and Sync(acyclic)

### Non real-time communication - as per DS301 + DS408

SDO	1 SDO (1 Server + 1 Client)
-----	-----------------------------

**(1)** Not for D-MP servopump drives

### Standard references

#### ISO 11898

Road Vehicles – Interchange of digital information controller area network (CAN) for High-speed communication

#### EN50325-4

Industrial communication subsystem based on ISO 11898 (CAN) for controller device interfaces

#### CiA DS301

CANopen – Application Layer and Communication Profile for Industrial Systems

#### CiA DR303-1

Cabling and connector pin assignment

#### CiA DSP305 (1)

CANopen – Layer Setting Services and Protocol

#### CiA DS408 (1)

CANopen – Device Profile for Proportional Hydraulic Valves v 1.5.2

### Programming interface

E-SW-FIELDBUS(/PQ), Z-SW-FULL and S-SW-SETUP software using proper cable/adaptor (see **GS500** and **GS800**) or CANopen master device

### Configuration file

EDS (Electronic Data Sheet) enclosed in USB memory stick of the programming software and in MyAtos area at [www.atos.com](http://www.atos.com)

### Manuals

E-MAN-S-BC enclosed in programming software E-SW-FIELDBUS(/PQ) and in MyAtos area at [www.atos.com](http://www.atos.com)

Z-MAN-S-BC enclosed in programming software Z-SW-FULL and in MyAtos area at [www.atos.com](http://www.atos.com)

S-MAN-BC enclosed in programming software S-SW-SETUP and in MyAtos area at [www.atos.com](http://www.atos.com)

## 2 PROFIBUS DP features for BP executions

### Physical

Serial input format	Industrial field-bus with optical insulation type PROFIBUS-DP RS485 European fieldbus standard (lev.1 – EN50170-part 2)
Transmission rate	Transmission rates from 9,6 Kbit/s to 12 Mbit/s
Max node	32 per segment without repeater; 126 node with repeater

### Communication Protocol

Data Link Layer	PROFIBUS DPV0 - IEC 61158 (type 3)
Device Profile	PROFIBUS-DP Profile for Fluid Power Technology <b>(1)</b>
Device type	Slave

### Startup and configuration

Boot up process	SAP 61 for sending parameter setting data SAP 62 for checking configuration data
Node setting	SAP 55 E-SW, Z-SW and S-SW programming software
Baudrate setting	Automatic
Baudrate	9,6 / 19,2 / 45,45 / 93,75 / 187,5 / 500 / 1500 / 3000 / 6000 / 12000 Kbit/s

### Fieldbus communication diagnostic

Device error	SAP 60
--------------	--------

### Real-time communication

PZD	Process data area of PPO telegram by Data Exchange, default SAP: cyclic transmission of standard Profibus frame
-----	--

#### Valve drivers and pump drivers

*PPO type 3, 113, 213, 230 for:*

AES, BM-AES, TES, BM-TEZ, LES, BM-LES, RES, BM-RES

*PPO type 5, 115, 214, 240 for:*

TES, BM-TEZ, LES, BM-LES, PES with alternated P/Q control

**Note:** PPO type 213, 230, 214, 240 are customizable by user

#### Axis controls

*PPO type 1, 111, 121, 123 for:*

TEZ, BM-TEZ, LEZ, BM-LEZ, BM-KZ

*PPO type 1, 101, 103, 111, 121, 123, 223, 227 for:*

TEZ, BM-TEZ, LEZ, BM-LEZ, BM-KZ with alternated P/Q control

**Note:** PPO type 223, 227 are customizable by user

#### Servopump drives

from 0 to 10 customizable Word - INPUT

from 0 to 10 customizable Word - OUTPUT

Cyclic mode	standard, sync and freeze
-------------	---------------------------

### Non real-time communication

PKW	Parameter data area of PPO telegram by Data Exchange, default SAP: acyclic transmission of standard Profibus frame (for D-MP servopump drives, PWK part may be enabled or disabled)
-----	---

**(1)** Not for D-MP servopump drives

### Standard references

#### *PROFIBUS profile*

PROFIBUS Profile,  
Fluid Power Technology,  
Edition Oct. 2001

#### *VDMA profile (1)*

Fluid Power Technology,  
Proportional Valves and  
Hydrostatic Transmissions, ver 1.1

### Programming interface

E-SW-FIELDBUS(PQ), Z-SW-FULL and S-SW-SETUP software using proper cable/adaptor (see **GS500** and **GS800**) or PROFIBUS DP master device

### Configuration file

GSD (General Station Description) enclosed in USB memory stick of the programming software and in MyAtos area at [www.atos.com](http://www.atos.com)

### Manuals

E-MAN-S-BP enclosed in programming software E-SW-FIELDBUS(PQ) and in MyAtos area at [www.atos.com](http://www.atos.com)

Z-MAN-S-BP enclosed in programming software Z-SW-FULL and in MyAtos area at [www.atos.com](http://www.atos.com)

S-MAN-BP enclosed in programming software S-SW-SETUP and in MyAtos area at [www.atos.com](http://www.atos.com)

### 3 EtherCAT features for EH executions

#### Physical

Serial input format	Industrial fieldbus type Fast Ethernet galvanically insulated IEC 61158-2
Transmission rate	2 x 100 Mbit/s (Fast Ethernet, Full-Duplex)
Max node	65535 slaves
Ethernet Standard	ISO/IEC 8802-3 frame format
EtherType	0x88A4 according to IEEE 802.3
Cable length	0,2 - 100m (between two slave devices)
Cable type	CAT5 (4 wire twisted pair) according with T568B
Network topology	Line, tree and star
Termination	Device internally

#### Communication Protocol

Data Link Layer	EtherCAT use Standard Ethernet Frames: ISO/IEC 8802-3 + IEC 61784-2
Device Profile	CANopen over EtherCAT (CoE) DS408 - Fluid Power Technology <b>(1)</b> and DS402 <b>(2)</b> EN 50325-4
Device type	Slave
Supported protocol	CANopen SDO Mailbox-Interface "CoE" Network Management PDO PDO Watchdog Cycle time min 1 msec

#### Startup and configuration - as per DS301 + DSP305

Node setting	Automatic position addressing Device node addressing
Baudrate	100 Mbit/s (Automatic)

#### Fieldbus communication diagnostic - as per DS301

Device Error	Emergency
--------------	-----------

#### Real-time communication - as per DS301 + DS408 + DS402

RPDO	4 PDOs messages to the valve drivers, pump drivers, axis controls and servopump drives (up to 32 byte for each PDO)
TPDO	4 PDOs messages from the valve drivers, pump drivers, axis controls and servopump drives (up to 32 byte for each PDO)
R(T)PDO types	Remotely requested

#### Non real-time communication - as per DS301 + DS408 + DS402

SDO	1 SDO (1 Server + 1 Client)
-----	-----------------------------

- (1)** Not for D-MP servopump drives  
**(2)** Only for D-MP servopump drives

#### Standard references

##### ISO 11898

Road Vehicles – Interchange of digital information controller area network (CAN) for High-speed communication

##### EN 50325-4

Industrial communication subsystem based on ISO 11898 (CAN) for controller device interfaces

##### CiA DS301

CANopen – Application Layer and Communication Profile for Industrial Systems

##### CiA DSP305

CANopen – Layer Setting Services and Protocol

##### CiA DS408 (1)

CANopen – Device Profile for Proportional Hydraulic Valves v 1.5.1

##### CiA DS402 (2)

CANopen – Device Profile for Drive and Motion Control v 4.0.0

##### IEC 61076-2-101

Connectors for electronic equipment  
- Product Requirements -  
Part 2-101: Circular connectors  
- Detail specification for M12 connectors with screw-locking

##### IEC 61158-2

Industrial communication networks  
- Fieldbus specification -  
Part 2: Physical layer specification and service definition

##### IEC 61784-2

Industrial communication networks  
- Profiles -  
Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3

#### Programming interface

E-SW-FIELDBUS(/PQ), Z-SW-FULL and S-SW-SETUP software using proper cable/adapter (see **GS500** and **GS800**) or EtherCAT master device

#### Configuration file

XML (Extensible Markup Language) enclosed in USB memory stick of the programming software and in MyAtos area at [www.atos.com](http://www.atos.com)

#### Manuals

E-MAN-S-EH enclosed in programming software E-SW-FIELDBUS(/PQ) and in MyAtos area at [www.atos.com](http://www.atos.com)

Z-MAN-S-EH enclosed in programming software Z-SW-FULL and in MyAtos area at [www.atos.com](http://www.atos.com)

S-MAN-EH enclosed in programming software S-SW-SETUP and in MyAtos area at [www.atos.com](http://www.atos.com)

**4 POWERLINK features for EW executions - not available for servopump drives**

**Physical**

Serial input format	Industrial fieldbus type Fast Ethernet galvanically insulated IEC 61158-2
Transmission rate	2 x 100 Mbit/s (Fast Ethernet, Half-Duplex)
Max node	239 slaves
Ethernet Standard	ISO/IEC 8802-3 frame format
EtherType	0x88AB according to IEEE 802.3
Integrated Hub	
Cable length	0,2 - 100m (between two slave devices)
Cable type	CAT5 (4 wire twisted pair) according with T568B
Network topology	Line, tree, star, daisy chain, ring structure or any combination of these topologies
Ethernet Hub	Integrated with 2 ports: - one led for Link/Activity indicator (on each port) - one bicolor led Status/Error indicator

**Communication Protocol**

Data Link Layer	POWERLINK use Standard Ethernet Frames: ISO/IEC 8802-3 + IEC 61784-2
Comm. Profile	EPG DS 301 v1.2
Device Profile	CANopen over Ethernet based on DS408 - Fluid Power Technology
Device type	Slave - supported features: - Ethernet POWERLINK v2.0 - Ring Redundancy - Support PollResponse Chaining - Support Multiplexing - Cycle time min 200 µsec - SDO Multiple Parameter Read/Write

**Startup and configuration (as per EPSG DS301 + EPSG DS 302-A/B/C/D/E)**

Node setting	E-SW and Z-SW programming software
Baudrate	100 Mbit/s (Automatic)

**Fieldbus communication diagnostic**

Custom parameters mappable on TPDO for emergency diagnosis

**Real-time communication (as per EPSG DS301 + DS408)**

RPDO	1 PDO message to the driver (max number of of mapping parameters is Device specific)
TPDO	1 PDO message from the driver (max number of of mapping parameters is Device specific)

**Standard references**

**EPG DS301**  
Ethernet POWERLINK  
Communication Profile Specification v 1.2

**EPG DS302-A/B/C/D/E**  
Ethernet POWERLINK  
Part A: High Availability v1.1  
Part B: Multiple ASnd v1.0  
Part C: PollResponse Chaining v1.0  
Part D: Multiple PReq/Pres v1.0  
Part E: Dynamic Node Allocation v1.0

**EPG DS311**  
Ethernet POWERLINK  
XML Device Description v 1.0

**CiA DS408**  
CANopen – Device Profile for Proportional Hydraulic Valves v 1.5.1

**IEC 61076-2-101**  
Connectors for electronic equipment  
- Product Requirements -  
Part 2-101: Circular connectors  
- Detail specification for M12 connectors with screw-locking

**IEC 61158-2**  
Industrial communication networks  
- Fieldbus specification -  
Part 2: Physical layer specification and service definition

**IEC 61784-2**  
Industrial communication networks  
- Profiles -  
Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3

**IEC 61784-3**  
Industrial communication networks  
- Profiles -  
Part 3: Functional safety fieldbuses -  
General rules and profile definitions

**IEC 61158-300/400/500/600**  
Industrial communication networks  
- Fieldbus specifications -  
Part 300: Data Link Layer service definition  
Part 400: Data Link Layer protocol specification  
Part 500: Application Layer service definition  
Part 600: Application Layer protocol specification

**ISO 15745-1**  
Industrial automation systems and integration - Open systems application integration framework -  
Part 1: Generic reference description

**Programming interface**

E-SW-FIELDBUS(/PQ) and Z-SW-FULL software using proper cable/adapter (see **GS500** and **GS800**) or POWERLINK master device

**Configuration file**

XDD (XML Device Description) enclosed in USB memory stick of the programming software and in MyAtos area at [www.atos.com](http://www.atos.com)

**Manuals**

E-MAN-S-EW enclosed in programming software E-SW-FIELDBUS(/PQ) and in MyAtos area at [www.atos.com](http://www.atos.com)

Z-MAN-S-EW enclosed in programming software Z-SW-FULL and in MyAtos area at [www.atos.com](http://www.atos.com)

**Physical**

Ethernet Standard	ISO/IEC 8802-3 frame format
EtherType	0x08E1 according to IEEE 802.3
Transmission rate	10/100 Mbit Full/Half-Duplex
Integrated	2-port switch
Cable length	max 100m
Cable type	CAT5 (4 wire twisted pair) according with T568B
Network topology	Device Level Ring (DLR), linear, star structure
Ethernet switch	integrated with two ports
Led indicator	2 led for Link/Activity indicator (on each port) and 1 bicolor led for Status/Error indicator

**Communication Protocol**

ODVA CIP Object Model

ODVA CIP Object library for Generic Device Profile

- Identity Object (0x01)
- Message Router Object (0x02)
- Assembly Object (0x04)
- Connection Manager Object (0x06)
- Parameter Object (0x0F)
- DLR Object (0x47)
- QoS Object (0x48h)
- Port Object (0xF4)
- TCP/IP Object (0xF5)
- Ethernet Link Object (0xF6)

Valve parameters accessible via Vendor Specific Object 0xA2

IP address setting (range 0.0.0.0 - 255.255.255.255):

- TCP/IP Object (0xF5)
- DHCP
- Auxiliary USB communication + Atos Software

I/O Adapter and Explicit Message Server device type

Cyclic data transmission via Implicit Messages (transport class 1)

- Minimum RPI for Implicit Messages 1ms
- Total number of supported class 1 connections: 4
- Up to 5 parameters and 20 bytes for each connection
- Trigger types: Cyclic CoS

Acyclic data transmission via Connected and Unconnected Explicit Messages (transport class 3)

- Minimum RPI for Explicit Messages 100ms
- No. of simultaneous Class 3 connections: 6

**Standard references**

*IEC 61918*

Industrial communication networks  
- Installation of communication networks in industrial premises

*IEC 61076-2-101*

Connectors for electronic equipment  
- Product Requirements -  
Part 2-101: Circular connectors  
- Detail specification for M12 connectors with screw-locking

*IEC 61158-1*

Industrial communication networks  
- Fieldbus specification -  
Part 1: Overview and guidance for the IEC 61158 and IEC 61784 series

*IEC 61158-2*

Industrial communication networks  
- Fieldbus specification -  
Part 2: Physical layer specification and service definition

*IEC 61784-1*

Industrial communication networks  
- Profiles -  
Part 1: Fieldbus profile

*IEC 61784-2*

Industrial communication networks  
- Profiles -  
Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3

*IEC 61784-3*

Industrial communication networks  
- Profiles -  
Part 3: Functional safety fieldbuses -  
General rules and profile definitions

*IEC 61784-5-2*

Industrial communication networks  
- Profiles -  
Part 5-2: Installation of fieldbuses -  
Installation profiles for CPF 2

*ISO 15745-4*

Industrial automation systems and integration - Open systems application integration framework -  
Part 4: Reference description for Ethernet-based control systems

**Programming interface**

E-SW-FIELDBUS(/PQ) and Z-SW-FULL software using proper cable/adaptor (see **GS500** and **GS800**) or EtherNet/IP scanner device

**Configuration file**

EDS (Electronic Data Sheet) enclosed in USB memory stick of the programming software and in MyAtos area at [www.atos.com](http://www.atos.com)

**Manuals**

E-MAN-S-EI enclosed in programming software E-SW-FIELDBUS(/PQ) and in MyAtos area at [www.atos.com](http://www.atos.com)

Z-MAN-S-EI enclosed in programming software Z-SW-FULL and in MyAtos area at [www.atos.com](http://www.atos.com)

## 6 PROFINET RT/IRT features for EP executions

### Physical

Ethernet Standard	ISO/IEC 8802-3 frame format
EtherType	0x8892 according to IEEE 802.3
Transmission rate	100 Mbit Full-Duplex
Integrated	2-port switch
Cable length	max 100m
Cable type	CAT5 (4 wire twisted pair) according with T568B
Network topology	line, star, tree and ring structure
Ethernet switch	integrated with two ports
Led indicator	2 led for Link/Activity indicator (on each port) 1 bicolor led for Status/Error indicator <b>(1)</b>

### Communication Protocol

Data Link Layer	PROFINET use Standard Ethernet Frames: ISO/IEC 8802-3 + IEC 61784-2
Device type	IO device - supported features: <ul style="list-style-type: none"><li>- complies with PROFINET IO conformance Class A, B, C</li><li>- Acyclic parameter Channel</li><li>- Real Time (RT) and Isochronous Real Time (IRT) communication</li><li>- Up to 8 input/output parameters for real time data exchange for valve drivers, pump drivers, axis controllers</li><li>- Up to 10 input/output parameters for real time data exchange for servopump drives</li><li>- PROFINET specific diagnostic support</li><li>- Media Redundancy Protocol (MRP)</li><li>- DCP Discovery and Configuration Protocol supported</li><li>- Identification &amp; Maintenance (I&amp;M)</li><li>- Cycle time min: 1 msec [RT] , 250 µsec [IRT]</li></ul>

### Startup and configuration

Address setting	IP Address and Station Name are assigned automatically by IO controller (e.g. Discovery and Configuration Protocol)
Baudrate	100 Mbit/s (Automatic)

### Fieldbus communication diagnostic

Custom parameters mappable on real time communication for emergency diagnosis

### Real-time communication

Modular config	for valve drivers and pump drivers: AES, BM-AES, TES, BM-TEZ, LES, BM-LES, RES, BM-RES, PES <ul style="list-style-type: none"><li>- up to 5 input parameters for real time data exchange</li><li>- up to 5 output parameters for real time data exchange</li></ul>
	for axis controls: TEZ, BM-TEZ, LEZ, BM-LEZ, BM-KZ <ul style="list-style-type: none"><li>- up to 8 input parameters for real time data exchange</li><li>- up to 8 output parameters for real time data exchange</li></ul>
	for servopump drives: D-MP <ul style="list-style-type: none"><li>- up to 10 input configurable parameters for real time data exchange</li><li>- up to 10 output configurable parameters for real time data exchange</li></ul>

**(1)** Not for D-MP servopump drives

### Standard references

#### IEC 61918

Industrial communication networks  
- Installation of communication networks in industrial premises

#### IEC 61076-2-101

Connectors for electronic equipment  
- Product Requirements -  
Part 2-101 **(1)**: Circular connectors  
- Detail specification for M12 connectors with screw-locking

#### IEC 61158-1

Industrial communication networks  
- Fieldbus specification -  
Part 1: Overview and guidance for the IEC 61158 and IEC 61784 series

#### IEC 61158-2

Industrial communication networks  
- Fieldbus specification -  
Part 2: Physical layer specification and service definition

#### IEC 61158-5-10

Industrial communication networks  
- Fieldbus specification -  
Part 5-10: Application layer service definition – Type 10 elements

#### IEC 61784-1

Industrial communication networks  
- Profiles -  
Part 1: Fieldbus profile

#### IEC 61784-2

Industrial communication networks  
- Profiles -  
Part 2: Additional fieldbus profiles for real-time networks based on ISO/IEC 8802-3

#### IEC 61784-5-3

Industrial communication networks  
- Profiles -  
Part 5-3: Installation of fieldbuses -  
Installation profiles for CPF 3

### Programming interface

E-SW-FIELDBUS(/PQ), Z-SW-FULL and S-SW-SETUP software using proper cable/adaptor (see **GS500** and **GS800**) or PROFINET controller

### Configuration file

GSDML (GSD Markup Language) enclosed in USB memory stick of the programming software and in MyAtos area at [www.atos.com](http://www.atos.com)

### Manuals

E-MAN-S-EP enclosed in programming software E-SW-FIELDBUS(/PQ) and in MyAtos area at [www.atos.com](http://www.atos.com)

Z-MAN-S-EP enclosed in programming software Z-SW-FULL and in MyAtos area at [www.atos.com](http://www.atos.com)

S-MAN-EP enclosed in programming software S-SW-SETUP and in MyAtos area at [www.atos.com](http://www.atos.com)